OHIO SPECIAL



100-225 HP Steam

Boiler Book 05/2018



BOILER BOOK OHIO SPECIAL

CONTENTS

FEATURES AND BENEFITS	 3
PRODUCT OFFERING	 3
DIMENSIONS AND RATINGS	 4
PERFORMANCE DATA	 4
ENGINEERING DATA	
ILLUSTRATIONS	
Space Required to Open Rear Head on Ohio Special Boilers Equipped with Davits	 7
Model CB Ohio Special Boilers Lifting Lug Location	
Model CB Ohio Special Boiler Mounting Piers	
Typical Gas Piping Layout	
Standard Gas Train Connection Size and Location	
No. 2 Oil Connection Size, Location and Recommended Line Sizes	 .16
No. 2 Oil Piping, Remote Oil Pump	
No. 2 Oil Piping, Multiple Boiler Installation	 .18
Boiler Room Length (Typical Layouts)	 .19
Boiler Room Width (Typical Layout)	 .19
TADI EC	
TABLES	_
Model CB Ohio Special Steam Boiler Ratings	
Model CB Ohio Special Steam Boiler Dimensions	
Model CB Ohio Special Boilers Heating Surface	
Steam Volume and Disengaging Area	
Safety Valve Openings	
Recommended Non-Return Valve Size	
Blowdown Tank Sizing Information	
Gas pressure requirements, CB Ohio Special	
Gas pressure altitude conversion	
Maximum gas consumption	
Gas Train Components	
MMO TIMILI COLLIDOLICITO TELETETETE EL TELETETETE EL TELETETETE DE LA COLLIDAD DE	

FEATURES AND BENEFITS

The Cleaver-Brooks Ohio Special Firetube boiler is designed, manufactured, and packaged by Cleaver-Brooks specifically for operation in the state of Ohio, under the rules and regulations for unattended units. The unique design of the Ohio Special Boiler serves your steam needs and reduces unnecessary labor costs. All units are factory fire tested and shipped as a package, ready for quick connection to utilities. In addition to the features provided on all Cleaver-Brooks Firetube boilers, the following features apply to the Ohio Specials.

Unique Dimple Tube Design:

- Ensures high gas turbulence and increased efficiency without turbulators, spinners, and other high maintenance devices.
- Dimple tubes also reduce the film coefficient on the gas side to transfer more heat, thus achieving greater output with less heating surface.

358 Square Feet of Heating Surface:

• The greatest amount offered in any packaged boiler for unattended steam boiler operation in Ohio - means long life and years of service at the high efficiencies.

Low Furnace Location:

- Furnace located well below water level with generous clearance from bottom of boiler, allowing proper circulation.
- Low furnace provides additional safety margin between furnace and water level.
- Reduces water carryover, producing drier steam.

PRODUCT OFFERING

Cleaver-Brooks Ohio Special Firetube boilers are available high pressure steam designs. Burners are available to fire natural gas, light oil, or a combination of oil and gas.

Ohio Special Boilers include:

- Four-pass dryback design (100 hp).
- Two-pass dryback design (125 225 hp).
- 15 psig low pressure steam.
- 150, 200, and 250 psig high pressure steam
- Natural gas or light oil firing.

Available options: For option details, contact your local Cleaver-Brooks authorized representative. In summary, options include the following:

Boiler Options

- Drain valves.
- Additional screwed or flanged trappings.
- Surge load baffles.
- Seismic design.
- Blowdown valves.
- Non-return valves.
- Feedwater valves and regulators.
- Special doors, davited, hinged, left swing.
- Special base rails.
- Surface blowdown systems.
- Weather-proofing.

Burner/Control Options

- Special modulation controls.
- Optional flame safeguard controller.
- Lead/lag system.
- Special insurance and code requirements (e.g., IRI, FM, CSD1).
- Remote contacts.
- Additional relay points and indicator lights.
- Main disconnect.
- Elapsed time meter.
- Voltmeter/micro-ampmeter.
- NEMA enclosures.
- Low fired hold controls.
- Remote emergency shut-off (115V).
- Circuit breaker.
- Day/night controls.
- Special power requirements.

Fuel Options

- Automatic fuel changeover.
- Oversized/undersized gas trains.
- Gas strainer.
- Special fuel shut-off valves.
- Special pilot.
- Alternate fuel firing.
- Special oil pumps.

DIMENSIONS AND RATINGS

For dimension and rating information for Ohio Special boilers, refer to the following tables and illustrations:

- Table 1. Model CB Ohio Special Steam Boiler Ratings.
- Table 2. Model CB Ohio Special Steam Boiler Dimensions.
- Figure 1. Space required to open rear head on Model CB Ohio Special Boilers Equipped with Davits.
- Figure 2. Lifting Lug Locations, Model CB Ohio Special Boilers.
- Figure 3. Model CB Ohio Special Boiler Mounting Piers.

PERFORMANCE DATA

For efficiency and emission data for Ohio Special Boilers, contact your local Cleaver-Brooks authorized representative.

Table 1: Model CB Ohio Special Steam Boiler Ratings

BOILER HP	100S	125S	150S	175S	200S	225S			
WEIGHT IN POUNDS									
Normal Water Capacity	4625	7000	7000	8500	8500	8500			
Approx Wt -15 psig	7800	9300	9300	12600	12600	12600			
Approx Wt -150 psig	8500	9900	9900	13500	13500	13500			
Approx Wt - 200 psig	9000	10500	10500	14200	14200	14200			
Water Capacity Flooded	5420	8673	8673	10485	10485	10485			
RATINGS SEA LEVEL TO 300	O FT								
Steam - Ibs/hr (212°F)	3450	4313	5175	6038	6900	7763			
Btu Output (1000 Btu/hr)	3348	4184	5021	5858	6695	7532			
APPROXIMATE FUEL CONSU	MPTION AT RA	ATED CAPACI	TIES						
Light Oil gph (140,000 Btu/gal)	29.9	37.4	44.8	52.3	59.8	67.2			
Nat Gas CFH (1000 Btu/cu-ft)	4184	5230	6277	7323	8369	9415			
Nat Gas -Therms/hr	41.8	52.3	62.8	73.2	83.7	94.1			
POWER REQUIREMENTS - ELECTRIC (60 Hz)									
Blower Motor, hp (all models)	3	5	7-1/2	10	15	20			
Oil Pump Motor, hp (No. 2 Oil)	1/3	1/2	1/2	1/2	1/2	1/2			
Air Compressor Motor hp (Oil Fired Only)	2	3	3	3	3	3			

NOTES:

1. Standard Voltage is 230 or 460/3/60 Hz.

2. Burner control circuit Voltage is 115/1/60 Hz,1/2 kVA load.

3. Side mounted air compressor (3 hp motor) recommended for 200S and 225S.

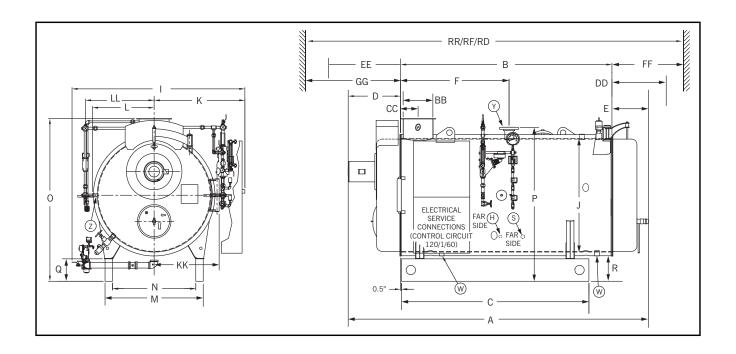


Table 2: Model CB Ohio Special Steam Boiler Dimensions

MODEL HP	DIM	100S	125S	150S	175S	200S	225S
			LENGTH	-	'	-	· ·
Overall (approximate)	Α	171-1/2	159-1/2	160-1/2	197-1/2	197-1/2	199-1/2
Shell	В	131	113	113	149	149	149
Base Frame	С	130	100	100	136	136	136
Front Head Extension (approximate)	D	22	27	28	29	29	31
Rear Head Extension	E	18-1/2	19-1/2	19-1/2	19-1/2	19-1/2	19-1/2
Flange to Nozzle (15 psig)	F	65-1/2	58	58	90	92	92
Flange to Nozzle (150 psig)	F	72.5	58	58	88	88	88
			WIDTH	1		-	
Overall (approximate)	I	73	85	85	85	85	85
ID Boiler	J	48	60	60	60	60	60
Center to Water Column	K	39	45	45	45	45	45
Center to Outside Hinge	KK	29	35	35	35	35	35
Center to Lagging	L	27	33	33	33	33	33
Center to Auxiliary LWCO	LL	34	40	40	40	40	40
Base-Outside	М	37-5/8	52-1/2	52-1/2	52-1/2	52-1/2	52-1/2
Base-Inside	N	29-5/8	44-1/2	44-1/2	44-1/2	44-1/2	44-1/2
		•	HEIGHT	'	'	'	'
Base to Vent Outlet	0	70	87	87	87	87	87
Base to Steam Outlet	Р	66	82-3/8	82-3/8	82-3/8	82-3/8	82-3/8
Base Frame	Q	12	12	12	12	12	12
Base to Bottom Boiler	R	16	16	16	16	16	16
		C	CONNECTIONS	'		'	
Chemical Feed	Н	1	1	1	1	1	1
Feedwater	S	1-1/4	1-1/2	1-1/2	1-1/2	1-1/2	1-1/2
Auxiliary Connection	Z	1	1	1	1	1	1
Steam Nozzle (15 psig) ^A	Y	8 FLG	8 FLG	8 FLG	8 FLG	10 FLG	10 FLG
Steam Nozzle (150 psig) ^B	Y	4 FLG	4 FLG	4 FLG	4 FLG	4 FLG	4 FLG
Drain-Front & Rear (15 psig only)	W	1-1/2	1-1/2	1-1/2	2	2	2
Blowdown-Front & Rear (150 psig)	W	1-1/4	1-1/2	1-1/2	1-1/2	1-1/2	1-1/2
Surface Blow (150 psig only)	T	1	1	1	1	1	1
Vent Stack Dia. (Flanged)	BB	12	16	16	16	16	16
Flange to Center Vent	CC	7	9	9	9	9	9

Table 2: Model CB Ohio Special Steam Boiler Dimensions (Continued)

MODEL HP	DIM	100S	1258	150S	175S	200S	225S
CLEARANCES					•	•	
Rear Door Swing	DD	55	32	32	32	32	32
Front Door Swing	EE	55	67	67	67	67	67
Tube Removal, Rear	FF	123	103	103	139	139	139
Tube Removal, Front	GG	113	91	91	127	127	127
Min Room Length for Rear Tube Removal	RR	309	283	283	355	355	355
Removal	RF	299	236	236	308	308	308
Tube Removal thru Door	RD	241	212	212	248	248	248

NOTE: Accompanying dimensions, while sufficiently accurate for layout purposes, must be confirmed for construction by certified dimension prints.

prints. A. Flanged 150 psig ANSI B. Flanged 300 psig ANSI

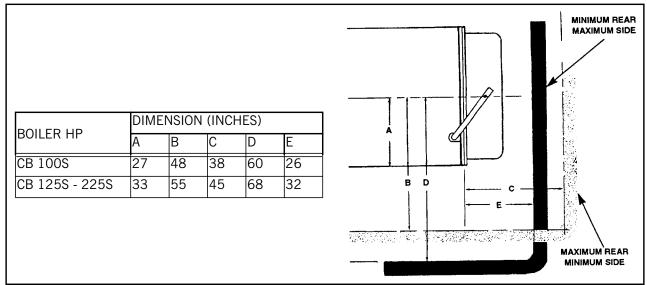


Figure 1. Space Required to Open Rear Head on Ohio Special Boilers Equipped with Davits


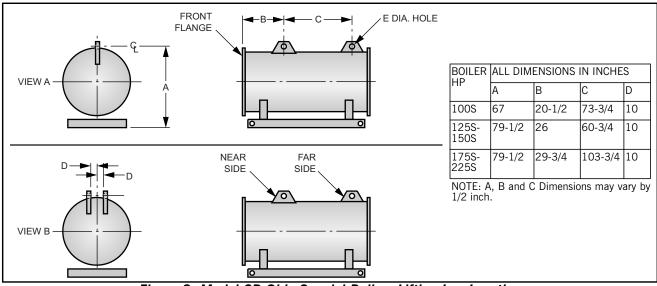


Figure 2. Model CB Ohio Special Boilers Lifting Lug Location

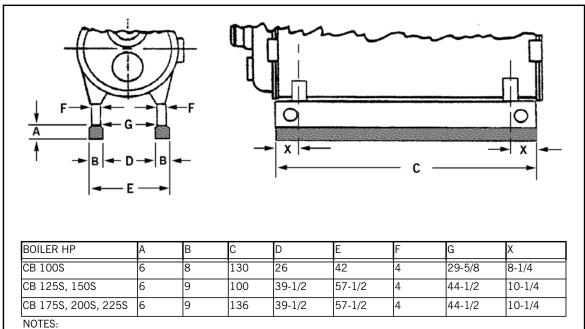

1. All numbers in table are in inches.

Figure 3. Model CB Ohio Special Boiler Mounting Piers

ENGINEERING DATA

The following engineering information is provided for the Ohio Special Boilers. Ohio Special boilers are designated by an "S" following the horsepower number. Additional detail is available from your local Cleaver-Brooks authorized representative.

Boiler Information

Table 3 shows heating surfaces for Model CB Ohio Special Boilers.

Table 4 shows steam volume and disengaging area for Model CB Ohio Special Boilers.

Table 5 lists quantity and outlet size for safety valves supplied on Model CB Ohio Special Boilers.

Table 6 gives recommended steam nozzle sizes based on 4000-5000 fpm steam velocity.s.

Table 7 shows recommended non-return valve sizes for Model CB Ohio Special Firetube Boilers.

Table 3: Model CB Ohio Special Boilers Heating Surface

BOILER HP	HEATING SURFACE (SQ-FT)				
ПГ	FIRESIDE	WATERSIDE			
100S	350	388			
125S-150S	358	386			
175S, 200S, 225S	358	384			

^{2. 6-}inch high mounting piers recommended for use beneath the boiler base frame. The use of these piers provides increased inspection accessibility to the piping beneath the boiler and added height for washing down the area beneath the boiler.

Table 4: Steam Volume and Disengaging Area

			<u> </u>		
BOILER HP	STEAM VOLUME CU-FT		STEAM RELIEVING AREA SQ-IN		
	HIGH PRESSURE ^A	LOW PRESSURE B	HIGH PRESSURE ^A	LOW PRESSURE B	
100S	14.3	23.7	4367	4975	
125S, 150S	27.3	30.6	4990	5132	
175S, 200S, 225S	37.2	41.6	6791	6984	

NOTES: Based on normal water level. A. Based on 150 psig design pressure. B. Based on 15 psig design pressure.

Table 5: Safety Valve Openings

VALVE SETTING	15 PSIG S	STEAM	100 PSIG	STEAM	125 PSIG	STEAM	150 PSIG	STEAM	200 PSIG	STEAM	250 PSIG	STEAM
HP	VALVES-	OUTLET SIZE (IN.)	VALVES-		VALVES	OUTLET SIZE (IN.)	VALVES-	SIZE	VALVES-	SIZE	VALVES	OUTLET SIZE (IN.)
100S	1	2-1/2	1	2	1	1-1/2	1	1-1/2	1	1-1/2	1	1-1/4
125S	1	2-1/2	1	2	1	2	1	2	1	1-1/2	1	1-1/2
150S	1	3	1	2-1/2	1	2	1	2	1	1-1/2	1	1-1/2
175S	1	3	1	2-1/2	1	2-1/2	1	2	1	2	1	1-1/2
200S	1	3	1	2-1/2	1	2-1/2	1	2-1/2	1	2	1	2
225S	2	2-1/2	2	2	1	2-1/2	1	2-1/2	1	2	1	2

NOTE:

Valve manufacturers are Kunkle, Consolidated or Conbraco, depending on availability.

Table 6: Recommended Steam Nozzle Size (for 4000 - 5000 fpm nozzle velocity)

	BOILER HP						
OPERATING PRESSURE PSIG	100S	125S	150S	175S	200S	225S	
15	8	8	8	8	10	10	
30	6	6	6	6	8	8	
40	6	6	6	6	6	8	
50	4	6	6	6	6	6	
75	4	4	4	6	6	6	
100	4	4	4	4	6	6	
125	4	4	4	4	4	4	
150	2.5	3	3	4	4	4	
200	2.5	2.5	3	3	4	4	

NOTES:

1. Steam nozzle sizes given in inches.

2. Recommended steam nozzle sizes based on 4000 to 5000 fpm steam velocity. Spool pieces (300 psig flanges) are available in the following sizes (in inches): 3x2-1/2x30, 4x3x30, 6x4x36, 8x6x48, and 10x8x48.

Table 7: Recommended Non-Return Valve Size

BOILER HP	BOILER CA- PACITY			OPERATI	NG PRESSUR	ES (PSIG)		
ПР	(LB/HR)	50	75	100	125	150	175	200
100S	3450	2-1/2	2-1/2	NA	NA	NA	NA	NA
125S	4313	3	2-1/2	2-1/2	2-1/2	NA	NA	NA
150S	5175	3	3	2-1/2	2-1/2	2-1/2	2-1/2	NA
175S	6038	3	3	2-1/2	2-1/2	2-1/2	2-1/2	NA
200S	6900	3*	3	3	3	3	2-1/2	2-1/2
225S	7736	3	3	3	3	3	2-1/2	2-1/2

NOTE:

Valve sizes (300# flanges) given in inches).

Table 8: Blowdown Tank Sizing Information

BOILER HP	WATER (GAL)
100\$	80
125S-150S	87
175S-225S	118

NOTE: Quantity of water removed from boiler by lowering normal water line 4"

Blowdown Water Requirements

Some local codes require blowdown tanks to be constructed in accordance with recommendations of the National Board of Boiler and Pressure Vessel Inspectors.

The National Board's recommendations base the size of the blowdown tank on the removal of at least 4 inches of water from the boiler.

Standard non-return valve selections limited to a maximum 2 to 1 turndown (50% of full boiler output); selection based on typical valve sizing recommendations. For final valve selection contact your authorized C-B representative.

^{*}Indicates pressure drop of less than 7.5 psig. All other selections are less than 6 psig pressure drop.

Table 9: Gas pressure requirements, CB Ohio Special

	o p	ocuro roquiromonio,		
BOILER HP	GAS TRAIN SIZE	UPSTREAM VALVE*	DOWNSTREAM*	GAS PRESSURE
100 HP	1.5 in	BB	BB	0.6 - 4.1 psi
100 HP	1.5 in	PC	PC	0.6 - 3.8 psi
125 HP	1.5 in	BB	BB	0.7 - 5.0 psi
125 HP	1.5 in	PC	PC	0.8 - 5.0 psi
150 HP	1.5 in	BB	BB	1.0 - 5.0 psi
150 HP	1.5 in	PC	PC	1.1 - 5.0 psi
175 HP	1.5 in	BB	BB	1.3 - 5.0 psi
175 HP	1.5 in	PC	PC	1.5 - 5.0 psi
175 HP	2.0 in	BB	BB	0.8 - 1.3 psi
175 HP	2.0 in	PC	PC	0.9 - 1.5 psi
200 HP	1.5 in	BB	BB	1.7 - 5.0 psi
200 HP	1.5 in	PC	PC	1.9 - 5.0 psi
200 HP	2.0 in	BB	BB	1.2 - 1.7 psi
200 HP	2.0 in	PC	PC	1.2 - 1.9 psi
225 HP	2.0 in	BB	BB	1.4 - 5.0 psi
225 HP	2.0 in	PC	PC	1.5 - 5.0 psi
225 HP	2.5 in	PC	PC	1.0 - 1.4 psi

^{*} BB = Butter Ball; PC = Plug Cock

Standard Gas Train is highlighted

Burner Information

The Ohio Special Firetube Boiler encompasses an integral front head that includes the burner, combustion air fan, and controls as part of the boiler package design.

The integral front head provides for burner/boiler design as a single unit maximizing the compatibility between the boiler and burner.

Gas-Fired Burners

Table 9 shows regulated gas pressure requirements for gas trains for CB Ohio Special Firetube Boilers.

Table 10 shows minimum required gas pressure altitude conversion.

Table 11 shows maximum gas consumption for natural gas and propane vapor.

Table 12 shows typical gas train components, and Figure 4 shows typical gas train piping layouts for multiple boiler applications.

Figure 5 shows standard gas train sizes and locations for Model CB Ohio Special Firetube Boilers.

Oil-Fired Burners

Fuel oil consumption information is shown on the boiler rating sheets in the Dimensions and Rating Section.

Figure 6 shows the oil connection sizes and locations for Ohio Special Boilers firing No. 2 oil.

Figures 7 and 8 show typical oil systems and layouts.

Boiler Room Information

Figure 9 shows typical boiler room length requirements.

Figure 10 shows typical boiler room width requirements.

Stack Support Capabilities

100 hp Ohio Special Boilers can support up to 1,000 lbs without additional support.

125-225 hp Ohio Special Boilers can support up to 2,000 lbs without additional support.

Table 10: Gas pressure altitude conversion

	_		
ALTITUDE (FT)	CORRECTION FACTOR	ALTITUDE (FT)	CORRECTION FACTOR
1000	1.04	6000	1.25
2000	1.07	7000	1.30
3000	1.11	8000	1.35
4000	1.16	9000	1.40
5000	1.21	-	-

To obtain minimum required gas pressure at altitudes above 700 feet, multiply the pressure by the listed factors: Inches WC x 0.577 = oz/sq-in.

 $Oz/sq-in \times 1.732 = Inches WC.$

Inches WC x 0.0361 = psig.

 $Oz/sq-in \times 0.0625 = psig.$ Psig x 27.71 = Inches WC.

Psig x 16.0 = Oz/sq-in.

Table 11: Maximum gas consumption

	TYPE OF GAS AND HEAT CONTENT								
BOILER HP	NATURAL GAS 1000 (Btu/cu-ft)	PROPANE GAS 2550 (Btu/cu-ft)							
100S	4185	1640							
125S	5230	2050							
150S	6280	2465							
175S	7350	2870							
200S	8370	3280							
225S	9415	3690							

Boiler Room Combustion Air

When determining boiler room air requirements, the size of the room, air flow, and velocity of air must be reviewed as follows:

- 1. Size (area) and location of air supply openings in boiler room.
 - A. Two (2) permanent air supply openings in the outer walls of the boiler room are recommended. Locate (1) at each end of the boiler room, preferably below a height of 7 feet. This allows air to sweep the length of the boiler.
 - B. Air supply openings can be louvered for weather protection, but they should not be covered with fine mesh wire, as this type of covering has poor air flow qualities and is subject to clogging by
 - C.A vent fan in the boiler room is not recommended, as it could create a slight vacuum under certain conditions and cause variations in the quantity of combustion air. This can result in unsatisfactory burner performance.
 - D.Under no condition should the total area of the air supply openings be less than (1) square foot.
 - E. Size the openings by using the formula:

Area (sq-ft) = cfm/fpm

- 2. Amount of air required (cfm).
 - A. Combustion air rated bhp x 8 cfm/bhp.
 - B. Ventilation air rated bhp x 2 cfm/bhp or a total of 10 cfm/bhp up to 1000 feet elevation. Add 3 percent more per 1000 feet of added elevation.
- 3. Acceptable air velocity in Boiler Room (fpm).

- A. From floor to (7) foot height 250 fpm.
- B.Above (7) foot height 500 fpm.
- C. Duct from air supply to boiler 1000 fpm.

Example: Determine the area of the boiler room air supply openings for (1) 200 hp boiler at 800 feet altitude. The air openings are to be 5 feet above floor level.

- Air required: $200 \times 10 = 2000 \text{ cfm (from 2B above)}$.
- Air velocity: Up to 7 feet = 250 fpm (from 3 above).
- Area Required: Area = cfm = 2000/250 = 8 Sq-ft total.
- Area/Opening: 8/2 = 4 sq-ft/opening (2 required).

Consult local codes, which may supersede these requirements.

Stack/Breeching Size Criteria

The design of the stack and breeching must provide the required draft at each boiler flue gas outlet. Proper draft is critical to burner performance.

Although constant pressure at the flue gas outlet of the Ohio Special is not required, it is necessary to size the stack/breeching to limit flue gas pressure variation. The allowable pressure range is -0.25" W.C. to +0.25" W.C.

Stack and breeching sizes should always be provided by a reputable stack supplier who will design the stack and breeching system based on the above criteria. Your local Cleaver-Brooks authorized representative is capable of assisting in your evaluation of the stack/breeching design.


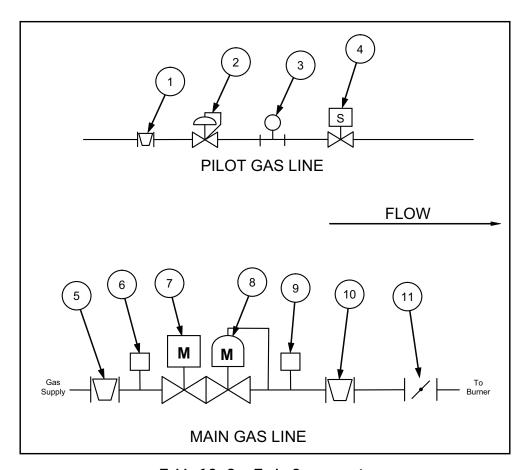


Table 12: Gas Train Components

		UL		FM		CSD-1	
ITEM	DESCRIPTION	100S	125S -	100S	125S -	100S	125S -
			225\$		225\$		225S
1	Pilot Shut Off Cock	Χ	Χ	Χ	Χ	Χ	Х
2	Pilot Pressure Regulator	Х	Х	Χ	Χ	Χ	Х
3	Pilot Pressure Gauge	X	Х	Χ	Χ	Χ	Х
4	Gas Pilot Valve	X	Х	Χ	Χ	Χ	X
5	Manual Shut Off Valve	X	Х	Χ	Χ	Χ	Х
6	Low Gas Pressure Switch	X	Х	Χ	Χ	Χ	X
7	Main Gas Valve w/o POC		Х		Х		Х
8	Regulating Gas Valve w/ POC	Х	Х	Х	Х	Х	Х
9	High Gas Pressure Switch	Х	Х	Χ	Χ	Х	Х
10	Manual Shut Off Valve	Х	Х	Х	Χ	Х	Х
11	Butterfly Valve	Х	Х	Χ	Χ	Χ	Х

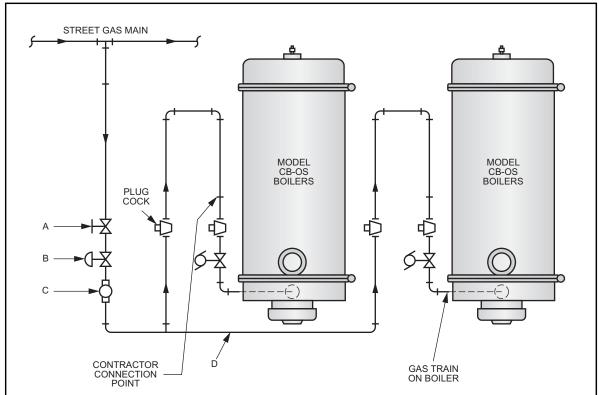

This figure illustrates the basic gas valve arrangement on Cleaver-Brooks boilers and shows the contractor's connection point. The valves and controls between the contractor connection point and the gas main in the street are representative of a typical installation. Actual requirements may vary depending on local codes or local gas company requirements which should be investigated prior to preparation of specifications and prior to construction.

- A. Utilities service valve.
- B. Utilities service regulator.
- C. Gas meter.
- D. Piping from meter to boiler.

The size of the gas line from the meter to the connection point at the boiler can be very important if gas pressures are marginal. The gas line sizing is dependent on:

- 1. Gas pressure at outlet of gas meter (C)
- 2. Rate of gas flow required, CFH3. Length of pipe run (D)
- 4. Pressure required at contractor connection point.

The local gas utility will advise the pressure that is available at the outlet of their meter.

Figure 4. Typical Gas Piping Layout

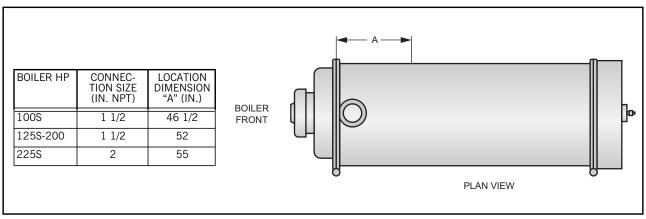


Figure 5. Standard Gas Train Connection Size and Location

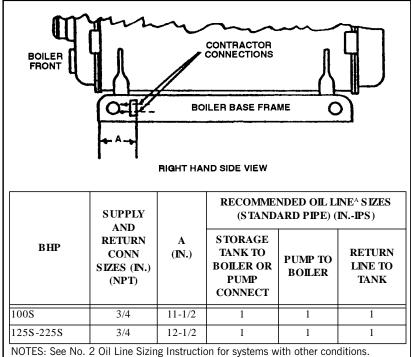


Figure 6. No. 2 Oil Connection Size, Location and Recommended Line Sizes

A. For suction line condition with a maximum of 10 Feet of lift and a total of 100 feet of suction line.

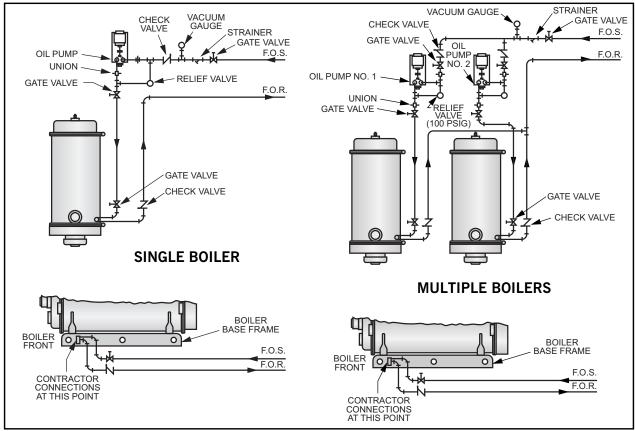


Figure 7. No. 2 Oil Piping, Remote Oil Pump


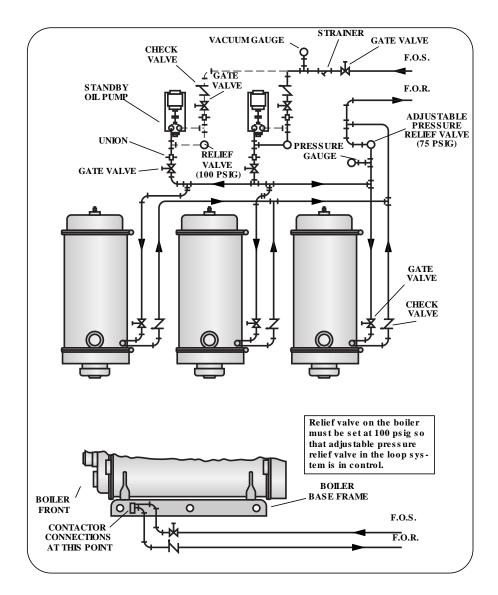


Figure 8. No. 2 Oil Piping, Multiple Boiler Installation

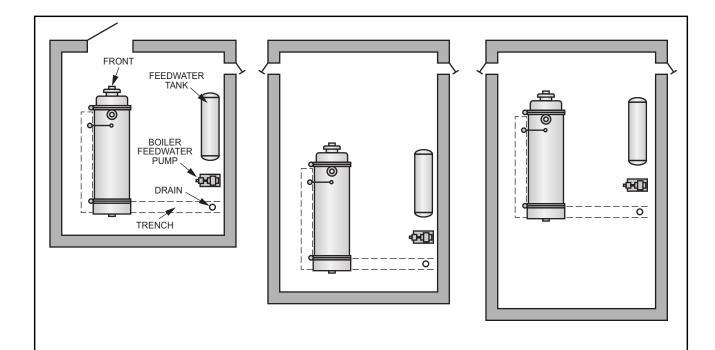

- 1. Shortest boiler room length (DWG A) is obtained by allowing for possible future tube replacement through a window or doorway. Allowance is only made for minimum door swing at each end of the boiler. This arrangement provides sufficient aisle space at the front of the boiler but a "tight" space condition at the rear. If space permits, approximately 1.5 additional feet should be allowed at the rear for additional aisle and working space.
- 2. Next shortest boiler room length (DWG B) is obtained by allowing for possible future tube replacement from the front of the boiler. Allowance is only made for minimum door swing at the rear. If space permits, approximately 1.5 additional feet should be allowed at the rear for additional aisle and working space.
- 3. A slightly longer boiler room for Model CB (DWG C) is obtained by allowing for possible future tube replacement from the rear of the boiler. Allowance for door swing at the front provides sufficient aisle and working space at the front.

Figure 9. Boiler Room Length (Typical Layouts)

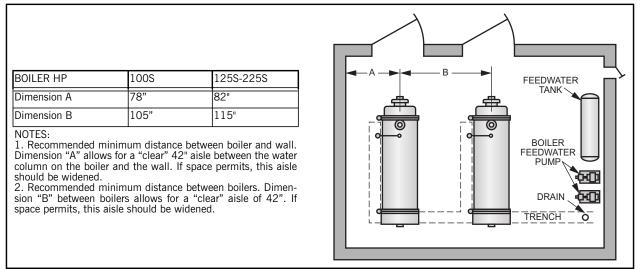


Figure 10. Boiler Room Width (Typical Layout)

