

# MODEL FLX



## Flexible Watertube Boilers

1.5 – 12.0 MMBTU/H Steam and Hot Water

Boiler Book  
03/2018



**TABLE OF CONTENTS**

FEATURES AND BENEFITS .....3  
 PRODUCT OFFERING .....4  
 DIMENSIONS AND RATINGS .....7  
 PERFORMANCE DATA .....17  
 ENGINEERING DATA .....17

**Illustrations**

FLX Steam Dimension Drawing .....7  
 FLX HW Dimension Drawing .....12  
 Model FLX Tube Attachment .....20  
 Model FLX Oil Burner Supply Pump Installation .....22  
 Model FLX Clearance Requirements .....24  
 Model FLX Breeching Arrangement - Single or Multiple Boiler Installation .....25

**Tables**

Model FLX Watertube Boiler Sizes .....4  
 FLX Steam Dimensions Sizes 150-500 .....8  
 FLX Steam Dimensions Sizes 550-1200 .....9  
 FLX Steam Ratings Sizes 150-550 .....10  
 FLX Steam Ratings Sizes 600-1200 .....11  
 FLX HW Dimensions Sizes 150-500 .....13  
 FLX HW Dimensions Sizes 550-1200 .....14  
 FLX HW Ratings Sizes 150-550 .....15  
 FLX HW Ratings Sizes 600-1200 .....16  
 Expected emissions (ppm, corrected to 3% O<sub>2</sub>), natural gas fired boiler .....17  
 Model FLX Hot Water Boiler Flow Rates and Pressure Drops .....18  
 Model FLX Circulating Rates, Hot Water Boiler .....18  
 Model FLX Minimum Over Pressure Requirements .....18  
 Model FLX Boiler Heat Release Information .....19  
 Model FLX Burner Characteristics .....20  
 Model FLX Minimum Required Gas Pressure .....21  
 Model FLX Sound Levels dBA .....23  
 Combustion Air Requirements .....25

## ***FEATURES AND BENEFITS***

### ***ASME Construction:***

- Built in accordance with the ASME Code, ensures design integrity for long life.
- Ensures safety and reliability with third party inspection of standards compliance.

### ***Underwriters Package Label [UL/cUL]:***

- Ensures the complete package [burner/boiler] has been tested and certified to the UL standards of safety and controls requirements.

### ***High Turndown Burner:***

- For standard emissions [uncontrolled], up to 10:1 turndown on Gas firing, reduces inefficient on/off operation, reducing fuel consumption.
- Boiler stays on line during low load conditions for optimum efficiency and performance.
- Airfoil damper design eliminates low fire excess air spikes, increasing combustion efficiency.
- Boiler/burner by single manufacturer eliminating divided responsibility.

### ***Hinged Burner Design:***

- Standard for all sizes of the Elite series and sizes 400 and greater on the Premium series, optional for Premium series sizes 350 and less.
- Burner assembly is attached to the front boiler wall with integral hinges, permits burner swing out for ease of service, maintenance, and inspection.

### ***Swedge-Fitted Tube Attachment:***

- Eliminates welded tube attachment to each drum providing ease of tube replacement.
- Eliminates rolling or welding of tube replacement, reduces maintenance costs.

### ***Thermal Stress Protection:***

- 25 Year Thermal Shock Warranty ensures tube integrity against thermal stress, associated with hydronic heating systems.
- Bent tube design provides ability to withstand thermal stress of tubes during rapid load swings and cold water returns.

### ***Removable Side Panel Casing:***

- Sectional side panels easily remove to provide access to each tube eliminates total casing removal for tube access.
- Reduces maintenance time and costs.

### ***Field Assembly Option:***

- Boiler can be erected on the project site where access space is minimized.
- Pressure vessel parts, tubes, burner and controls can fit through a standard doorway, elevator shaft or reduced side wall opening or window.

## PRODUCT OFFERING

Information in this section applies to steam and hot water boiler sizes ranging from 1.5 to 12 MMBtu/hr input, as shown in Table 1

The Flexible Watertube Boiler is a five-pass steel boiler with flexible tubes formed and arranged to direct the flow of combustion gases through the boiler. The pressure vessel conforms to Section I or Section IV of the ASME Code, and consists of the formed tubes and the external downcomer connected to the top and bottom drums. The heated area of the pressure vessel is contained within a gas-tight, insulated casing that is composed of removable, formed-steel panels. The boiler/burner package is manufactured by Cleaver-Brooks and is UL/cUL approved as a package.

**Table 1: Model FLX Watertube Boiler Sizes**

MODEL	CAPACITY INPUT BTU/HR	HEAT OUTPUT BTU/HR	EQUIV HP
FLX-150	1,500,000	1,200,000	36
FLX-200	2,000,000	1,600,000	48
FLX-250	2,500,000	2,000,000	60
FLX-300	3,000,000	2,400,000	72
FLX-350	3,500,000	2,800,000	84
FLX-400	4,000,000	3,200,000	96
FLX-450	4,500,000	3,600,000	108
FLX-500	5,000,000	4,000,000	119
FLX-550	5,500,000	4,400,000	132
FLX-600	6,000,000	4,800,000	143
FLX-700	7,000,000	5,600,000	167
FLX-800	8,000,000	6,400,000	191
FLX-900	9,000,000	7,200,000	215
FLX-1000	10,000,000	8,000,000	239
FLX-1100	11,000,000	8,800,000	263
FLX-1200	12,000,000	9,600,000	287

NOTES:

1. Design Pressure: 150 psig Hot Water, 15 psig Steam, 150 psig Steam.
2. Also available in Model FLE (field erectable).

### **Standard Equipment**

Equipment described below is for the standard factory package offering.

1. Boiler:

- All boilers are designed and constructed in accordance with the ASME Code.
- Each vessel is mounted on an integral base frame; refractories for the boiler and burner are installed.
- Each vessel receives a factory hydro test with third party witness.
- ASME Code Stamped and National Board Registered.
- For Canadian installations, appropriate CRN Stamping.

***Hot water boilers with design pressures up to 150 psig, and with design temperatures less than 250 °F, are constructed under Section IV of the ASME Code, and 'H' stamped for low- pressure heating boilers.***

***Steam boilers with design pressure of 30 psig, and maximum allowable operating pressure of 15 psig, are constructed under Section IV of the ASME Code, and 'H' stamped for low pressure heating boilers.***

***Steam boilers with design pressure of 150 psig are constructed under Section I of the ASME code and "S" stamped for high pressure steam boilers.***

2. Forced Draft Burner, Cleaver-Brooks ProFire™ V Series:

- Mounted on a hinged backing plate for easy access to furnace. Note: Standard on all sizes Elite Series and sizes 400 and larger Premium Series.
- Pressure atomizing type for No. 2 oil burner. This includes the oil pump.
- Stainless steel flame-retention type combustion head for gas, with UV scanner and gas pressure regulator.
- External access to flame scanner for ease of maintenance.

3. Water/Steam Controls:

- ASME safety relief valve(s).
- Pressure and temperature gauges for hot water boilers.
- Pressure gauge for steam boilers.
- Operating and limit controls:
  - High limit control - manual reset.
  - Operating limit control - automatic reset.
- Modulating or proportional controller.
- Low water cutoff:
  - Probe type - hot water.
  - Float type main and probe type auxiliary for steam.
- Pump Control - steam boilers.

4. Altitude: Standard boilers attain full ratings at altitudes up to 2,000 feet. Altitude compensation for most models is available for altitudes up to 10,000 ft above sea level.

### ***Optional Equipment***

For option details, contact your local Cleaver-Brooks authorized representative. In summary, options include the following:

#### 1. Boiler Options

- Auxiliary low water cut-off (hot water).
- Stack thermometer.
- Insulated downcomer(s).
- Drain valves.
- Additional screwed tappings.
- Packaged for field erection.

#### 2. Burner/Control Options

- Special burner modulation controls.
- Low NOx burner.
- Optional flame safeguard controller.
- Lead/lag system.
- High altitude design - up to 10,000 ft.
- Special insurance and code requirements (e.g., XL-GAPS, FM, ASME CSD-1).
- Alarm bell/silence switch.
- Special motor requirements (TEFC, high efficiency).
- Remote contacts.
- Additional relay points and indicator lights.
- Main disconnect (fusible/circuit breaker).
- Optional NEMA enclosures.
- Key lock panel.
- System pump interlock.
- Low fire hold controls.
- Assured low fire cut-off.
- Flow switches.
- High stack temperature cut-off/alarm.
- Remote emergency shutoff (115V).

#### 3. Fuel Options

- Special gas pressure regulator.
- Oversized gas trains.
- Gas strainer.
- Special fuel shut-off valves.
- Digester gas.
- Remote oil pump set.
- Special pilot.
- Direct spark oil ignition.
- Automatic fuel changeover.

## DIMENSIONS AND RATINGS

**Figure 1: FLX Steam Dimension Drawing**

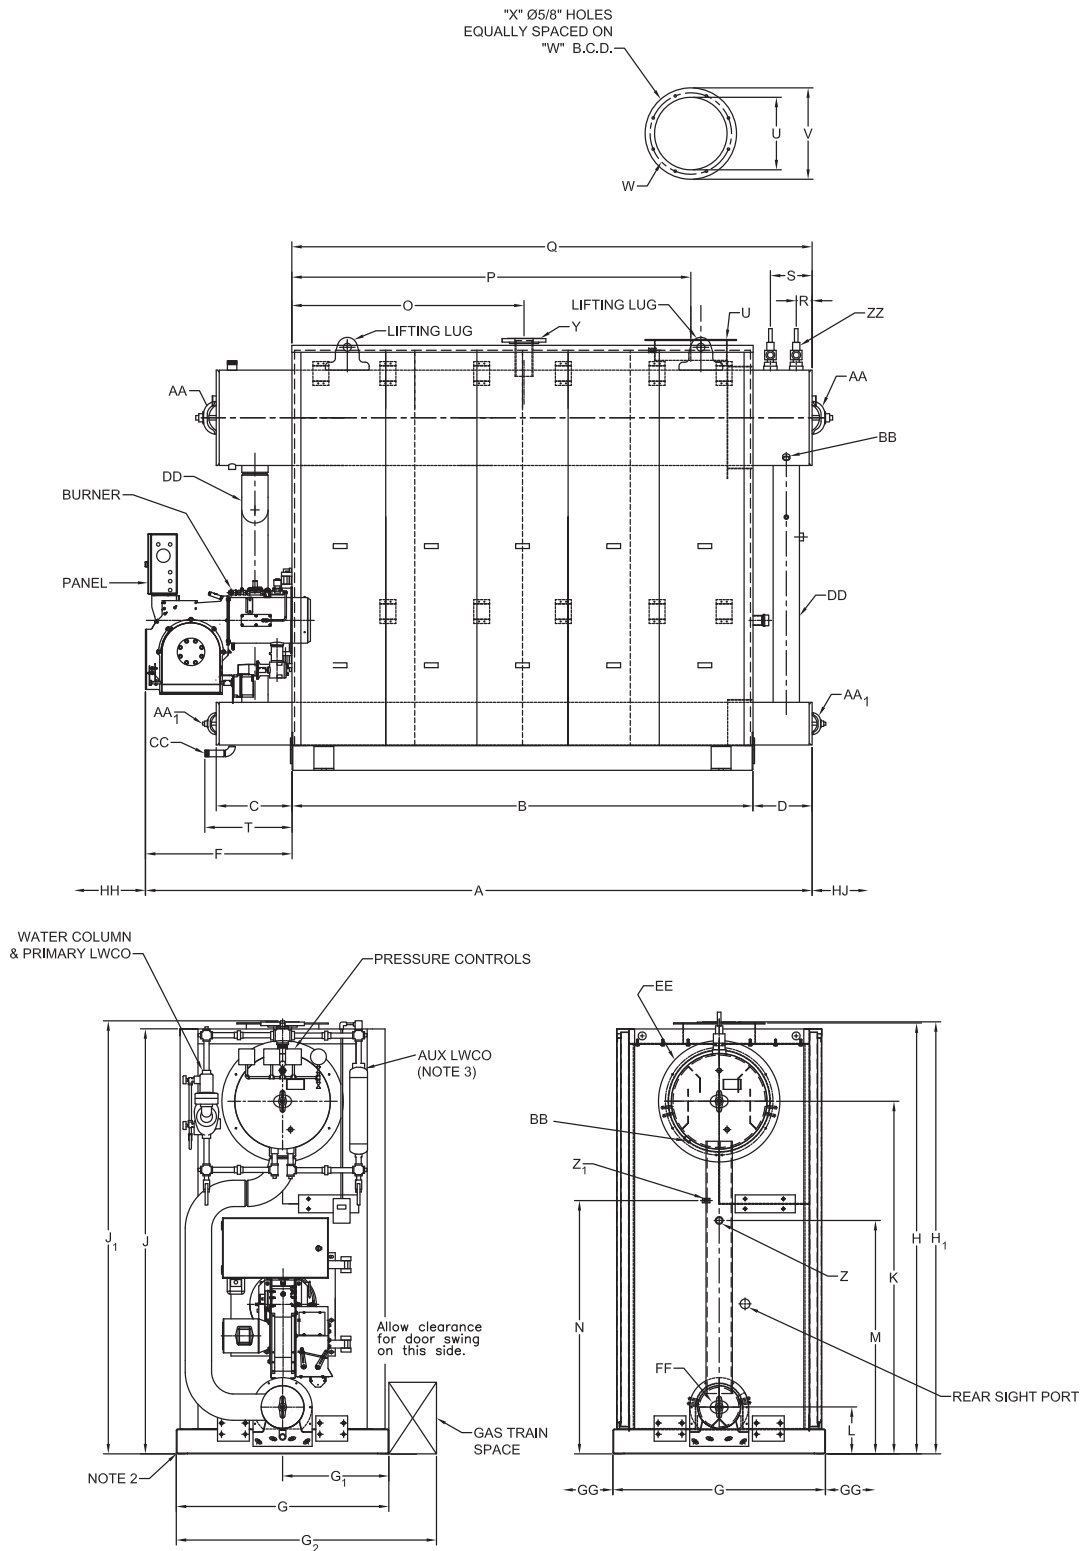


Table 2: FLX Steam Dimensions Sizes 150-500

		BOILER SIZE - NOTE 1							
		150	200	250	300	350	400	450	500
<b>LENGTHS Inches</b>									
Overall	<b>A</b>	108	108	108	114	114	139	139	139
Boiler Base Frame	<b>B</b>	68	68	68	74	74	94	94	94
Front Extension Lower Drum	<b>C</b>	15	15	15	15	15	17	17	17
Rear Extension Lower Drum	<b>D</b>	13	13	13	13	13	13	13	13
Burner Extension	<b>F</b>	27	27	27	27	27	31	31	31
<b>WIDTHS Inches</b>									
Boiler Base Frame [See Note 2]	<b>G</b>	42	42	42	46	46	48	48	48
Centerline to Casing	<b>G<sub>1</sub></b>	41	41	41	23	23	24	24	24
Width to outside of Gas Train	<b>G<sub>2</sub></b>	54	54	54	58	58	60	60	60
<b>HEIGHTS Inches</b>									
Base to Stack Flange	<b>H</b>	86	86	86	90	90	95	95	95
Base to Steam Nozzle	<b>H<sub>1</sub></b>	87	87	87	91	91	95	95	95
Base to Top of Casing	<b>J</b>	85	85	85	89	89	93	93	93
Base to Lifting Lug	<b>J<sub>1</sub></b>	86	86	86	90	90	95	95	95
Base to Upper Drum Centerline	<b>K</b>	69	69	69	73	73	77	77	77
Base to Lower Drum Centerline	<b>L</b>	9	9	9	9	9	10	10	10
Base to Feedwater Connection	<b>M</b>	39	39	39	43	43	47	47	47
Base to Chemical Feed	<b>N</b>	44	44	44	48	48	52	52	52
<b>LOCATIONS Inches</b>									
Front Casing to Steam Nozzle	<b>O</b>	34	34	34	37	37	47	47	47
Flue Outlet Centerline	<b>P</b>	55	55	55	61	61	80	80	80
Front Casing to Upper Drum Rear	<b>Q</b>	81	81	81	87	87	108	108	108
Safety Valves <b>15 PSIG Setpoint</b>	<b>R</b>	4	4	4	4	4	4	4	4
Safety Valves <b>15 PSIG Setpoint</b>	<b>S</b>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Safety Valves <b>150 PSIG Setpoint</b>	<b>R</b>	4	4	4	4	4	4	4	4
Safety Valves <b>150 PSIG Setpoint</b>	<b>S</b>	N/A	N/A	N/A	N/A	N/A	9-1/2	9-1/2	9-1/2
Bottom Drain/Blowdown	<b>T</b>	20	20	20	21	21	23	23	23
<b>PIPING CONNECTIONS Inches</b>									
Flue Gas ID	<b>U</b>	10	10	10	12	12	16	16	16
Flue Gas Outlet Flange	<b>V</b>	15	15	15	17	17	21	21	21
Flange Bolt Circle Diameter	<b>W</b>	12-1/2	12-1/2	12-1/2	14-1/2	14-1/2	18-1/2	18-1/2	18-1/2
Number of Bolt Holes	<b>X</b>	4	4	4	4	4	6	6	6
Steam Nozzle 15 PSIG Design Boiler	<b>Y</b>	4 flg.	4 flg.	4 flg.	6 flg.	6 flg.	6 flg.	6 flg.	8 flg.
Steam Nozzle 150 PSIG Design Boiler	<b>Y</b>	2 mpt	2 mpt	2 mpt	2½ mpt	2½ mpt	3 flg.	3 flg.	3 flg.
Feedwater Makeup	<b>Z</b>	1¼	1¼	1¼	1¼	1¼	1¼	1¼	1¼
Chemical Feed	<b>Z<sub>1</sub></b>	½	½	½	½	½	½	½	½
Surface Blowff	<b>BB</b>	1	1	1	1	1	1	1	1
Bottom Drain/Blowdown 15 PSIG Design	<b>CC</b>	1½	1½	1½	1½	1½	2	2	2
Bottom Drain/Blowdown 150 PSIG Design	<b>CC</b>	1¼	1¼	1¼	1¼	1¼	1¼	1¼	1¼
Safety Valves, 15 psig [Note 4]	<b>ZZ</b>	1 @ 2	1 @ 2	1 @ 2	1 @ 2½	1 @ 2½	1 @ 3	1 @ 3	1 @ 3
Safety Valves, 150 psig [Note 4]	<b>ZZ</b>	1 @ 1¼	1 @ 1¼	1 @ 1¼	1 @ 1½	1 @ 1½	2 @ 1¼	2 @ 1¼	2 @ 1¼
<b>GENERAL DATA</b>									
Handhole Upper Drum	<b>AA</b>	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6
Handhole Lower Drum	<b>AA<sub>1</sub></b>	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5
Downcomer OD	<b>DD</b>	4	4	4	4	4	5	5	5
Upper Drum OD	<b>EE</b>	20	20	20	20	20	20	20	20
Lower Drum OD	<b>FF</b>	8-5/8	8-5/8	8-5/8	8-5/8	8-5/8	10-3/4	10-3/4	10-3/4
<b>MINIMUM SERVICE CLEARANCES</b>									
Tube removal each side	<b>GG</b>	28	28	28	32	32	34	34	34
Rear service area	<b>HJ</b>	24	24	24	24	24	24	24	24
Front service area -	<b>HH</b>	36	36	36	36	36	36	36	40

Dimension letters E and I are not used.

**NOTES:**

1. Multiply Size by 10,000 to obtain BTU/hr input of the boiler.
2. Add 4 inches to each side of the base frame dimension to account for optional seismic anchor pads on each side.
3. For unit sizes beloww 700, the ALWCO [auxiliary low water cutoff] is a probe device in lieu of the column.
4. Connections shown are for valve outlet connection at the standard set point, do not reduce outlet pipe size.



**Table 3: FLX Steam Dimensions Sizes 550-1200**

		BOILER SIZE - NOTE 1							
		550	600	700	800	900	1000	1100	1200
<b>LENGTHS Inches</b>									
Overall	<b>A</b>	139	145	168	168	168	200	200	205
Boiler Base Frame	<b>B</b>	94	94	116	116	116	140	140	140
Front Extension Lower Drum	<b>C</b>	17	17	17	17	17	19	19	19
Rear Extension Lower Drum	<b>D</b>	13	13	15	15	15	23	23	23
Burner Extension	<b>F</b>	31	37	37	37	37	37	37	43
<b>WIDTHS Inches</b>									
Boiler Base Frame [See Note 2]	<b>G</b>	48	48	54	54	54	54	54	54
Centerline to Casing	<b>G<sub>1</sub></b>	24	24	27	27	27	27	27	27
Width to outside of Gas Train	<b>G<sub>2</sub></b>	60	60	66	66	66	66	66	66
<b>HEIGHTS Inches</b>									
Base to Stack Flange	<b>H</b>	95	95	109	109	109	108.5	108.5	108.5
Base to Steam Nozzle	<b>H<sub>1</sub></b>	95	95	109	109	109	109	109	109
Base to Top of Casing	<b>J</b>	93	93	107	107	107	107	107	107
Base to Lifting Lug	<b>J<sub>1</sub></b>	95	95	109	109	109	109	109	109
Base to Upper Drum Centerline	<b>K</b>	77	77	89	89	89	89	89	89
Base to Lower Drum Centerline	<b>L</b>	10	10	12	12	12	12	12	12
Base to Feedwater Connection	<b>M</b>	47	47	59	59	59	59	59	59
Base to Chemical Feed	<b>N</b>	52	52	64	64	64	64	64	64
<b>LOCATIONS Inches</b>									
Front Casing to Steam Nozzle	<b>O</b>	47	47	58	58	58	58	58	58
Flue Outlet Centerline	<b>P</b>	80	80	100	100	100	124	124	124
Front Casing to Upper Drum Rear	<b>Q</b>	108	108	131	131	131	163	163	163
Safety Valves <b>15 PSIG Setpoint</b>	<b>R</b>	4	4	4	4	4	4	4	4
Safety Valves <b>150 PSIG Setpoint</b>	<b>R</b>	4	4	4	4	4	4	4	4
Safety Valves <b>150 PSIG Setpoint</b>	<b>S</b>	9-1/2	9-1/2	10-1/2	10-1/2	10-1/2	10-1/2	10-1/2	10-1/2
Bottom Drain/Blowdown	<b>T</b>	23	23	22	22	22	22	22	22
<b>PIPING CONNECTIONS Inches</b>									
Flue Gas ID	<b>U</b>	16	16	18	18	18	24	24	24
Flue Gas Outlet Flange	<b>V</b>	21	21	23	23	23	29	29	29
Flange Bolt Circle Diameter	<b>W</b>	18-1/2	18-1/2	20-1/2	20-1/2	20-1/2	26-1/2	26-1/2	26-1/2
Number of Bolt Holes	<b>X</b>	6	6	8	8	8	8	8	8
Steam Nozzle 15 PSIG Design Boiler	<b>Y</b>	8 flg.	8 flg.	8 flg.	8 flg.	8 flg.	10 flg.	10 flg.	10 flg.
Steam Nozzle 150 PSIG Design Boiler	<b>Y</b>	3 flg.	3 flg.	4 flg.	4 flg.	4 flg.	6 flg.	6 flg.	6 flg.
Feedwater Makeup	<b>Z</b>	1 1/4	1 1/4	1 1/2	1 1/2	1 1/2	2	2	2
Chemical Feed	<b>Z<sub>1</sub></b>	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
Surface Blowff	<b>BB</b>	1	1	1	1	1	1	1	1
Bottom Drain/Blowdown 15 PSIG Design	<b>CC</b>	2	2	2	2	2	2	2	2
Bottom Drain/Blowdown 150 PSIG	<b>CC</b>	1 1/4	1 1/4	1 1/4	1 1/4	1 1/4	1 1/4	1 1/4	1 1/4
Safety Valves, 15 psig [Note 4]	<b>ZZ</b>	1 @ 3	1 @ 3	2 @ 2 1/2	2 @ 2 1/2	2 @ 2 1/2	2 @ 3	2 @ 3	2 @ 3
Safety Valves, 150 psig [Note 4]	<b>ZZ</b>	2 @ 1 1/4	2 @ 1 1/4	2 @ 1 1/2	2 @ 1 1/2	2 @ 1 1/2	2 @ 2	2 @ 2	2 @ 2
<b>GENERAL DATA</b>									
Handhole Upper Drum	<b>AA</b>	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6	4 x 6
Handhole Lower Drum	<b>AA<sub>1</sub></b>	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5	4 x 5
Downcomer OD	<b>DD</b>	5	5	6	6	6	6	6	6
Upper Drum OD	<b>EE</b>	20	20	24	24	24	24	24	24
Lower Drum OD	<b>FF</b>	10-3/4	10-3/4	10-3/4	10-3/4	10-3/4	10-3/4	10-3/4	10-3/4
<b>MINIMUM SERVICE CLEARANCES</b>									
Tube removal each side	<b>GG</b>	34	34	40	40	40	40	40	40
Rear service area	<b>HJ</b>	24	24	24	24	24	24	24	24
Front service area -	<b>HH</b>	40	40	40	40	40	45	45	45

Dimension letters E and I are not used.

**NOTES:**

1. Multiply Size by 10,000 to obtain BTU/hr input of the boiler.
2. Add 4 inches to each side of the base frame dimension to account for optional seismic anchor pads on each side.
3. For unit sizes beloww 700, the ALWCO [auxiliary low water cutoff] is a probe device in lieu of the column.
4. Connections shown are for valve outlet connection at the standard set point, do not reduce outlet pipe size.

**Table 4: FLX Steam Ratings Sizes 150-550**

Boiler SIZE	150	200	250	300	350	400	450	500	550
<b>Ratings [Notes A and B]</b>									
Steam Capacity (lbs. steam/hr from & at 212° F.)	1,242	1,656	2,070	2,484	2,898	3,312	3,726	4,106	4,520
Steam Capacity [kg/hr from and at 100 C]	563	751	939	1,127	1,315	1,502	1,690	1,862	2,050
Output Btu/hr	1,205,100	1,606,800	2,008,500	2,410,200	2,811,900	3,213,600	3,615,300	3,983,525	4,385,225
Output Kcal/Hr	303,696	404,928	506,160	607,392	708,624	809,856	911,088	1,003,884	1,105,116
Output kW	353	471	589	706	824	942	1,060	1,168	1,285
Output Boiler Horsepower	36	48	60	72	84	96	108	119	131
<b>Approximate Fuel Consumption [ Input - Note C]</b>									
Natural Gas [ft <sup>3</sup> /hr] - 15 PSI Steam	1,452	1,936	2,435	2,904	3,388	3,872	4,356	4,799	5,283
Natural Gas Therms/Hour - 15 PSI Steam	14.5	19.4	24.3	29.0	33.9	38.7	43.6	48.0	52.8
Natural Gas [m <sup>3</sup> /hr] - 1.03 Bar	41.1	54.8	68.9	82.2	95.9	109.6	123.3	135.9	149.6
Natural Gas [ft <sup>3</sup> /hr] - 150 PSI Steam	1,506	2,009	2,511	3,013	3,515	4,017	4,519	4,979	5,482
Natural Gas Therms/Hour - 150 PSI Steam	15.1	20.1	25.1	30.1	35.1	40.2	45.2	49.8	54.8
Natural Gas [m <sup>3</sup> /hr] - 10.34 Bar	42.7	56.9	71.1	85.3	99.5	113.7	128.0	141.0	155.2
Propane Gas [ft <sup>3</sup> /hr] - 15 PSI Steam	581	774	974	1,162	1,355	1,549	1,742	1,920	2,113
Propane Gas [ft <sup>3</sup> /hr] - 150 PSI Steam	595	793	992	1,190	1,389	1,587	1,785	1,967	2,166
Propane Gas [m <sup>3</sup> /hr] - 1.03 Bar	16.4	21.9	27.6	32.9	38.4	43.9	49.3	54.4	59.8
Propane Gas [m <sup>3</sup> /hr] -10.34 Bar	16.9	22.5	28.1	33.7	39.3	44.9	50.6	55.7	61.3
No.2 Oil Fuel - gph, 15 PSI Steam	10.2	13.8	17.3	20.7	24.2	27.7	31.1	34.3	37.7
No.2 Oil Fuel - gph, 150 PSI Steam	10.4	14.2	17.7	21.3	24.8	28.3	31.9	35.1	38.7
No.2 Oil Fuel - liters/hour, 1.03 Bar	38.7	52.3	65.3	78.4	91.5	104.5	117.6	129.6	142.7
No.2 Oil Fuel - liters/hour, 10.34 Bar	39.2	53.6	67.0	80.3	93.7	107.1	120.5	132.8	146.2
<b>Power Requirements - Uncontrolled Emissions [Notes A and D]</b>									
Blower Motor HP - Gas Firing	1/2	3/4	3/4	3/4	1	1	2	2	3
Blower Motor kW - Gas Firing	0.378	0.5595	.5595	.5595	0.746	0.746	1.492	1.492	2.238
Blower Motor HP - Oil or Combination	3/4	1	1	1	1-1/2	1-1/2	2	3	3
Blower Motor kW - Oil or Combination	.5595	0.746	0.746	0.746	1.119	1.119	1.492	2.238	2.238
Oil Pump for Oil or Combination	Direct Drive from the Blower Motor								
<b>Minimum Ampacity - Standard</b>									
Blower Motor - Gas Firing Only, [115]230/1/60	[9.8] 4.9	[13.8] 6.9	[13.8] 6.9	[13.8] 6.9	[16] 8	[16] 8	[24] 12		
Blower Motor - Oil or Combination, [115]230/1/60	[13.8] 6.9	[16] 8	[16] 8	[16] 8	[20] 10	[20] 10	[24] 12		
Blower Motor - Gas, 230/3/60								6.8	9.6
Blower Motor - Oil or Combination, 230/3/60								9.6	9.6
Blower Motor - Gas, 460/3/60								3.4	4.8
Blower Motor - Oil or Combination, 460/3/60								4.8	4.8
Blower Motor - Gas, Oil or Combination, 400/3/50								2.8	4.2
Blower Motor - Gas, 575/3/60								2.7	3.9
Blower Motor - Oil or Combination, 575/3/60								3.9	3.9
Remote Oil Pump, [230]460/3/60									
Control Circuit @115/1/60	1.7	1.7	1.7	1.9	1.9	1.9	2.4	2.4	2.4
<b>Weights</b>									
Operating Weight, lbs.	6,600	6,600	6,600	7,200	7,200	9,200	9,200	9,200	9,200
Operating Weight, kg	2,994	2,994	2,994	3,266	3,266	4,173	4,173	4,173	4,173
Water Content Normal, gallons	108	108	108	121	121	157	157	157	157
Water Content Normal, liters	409	409	409	458	458	594	594	594	594
Water Content Flooded, gallons	194	194	194	215	215	293	293	293	293
Water Content Flooded, liters	734	734	734	814	814	1109	1109	1109	1109
Shipping Weight, approximate lbs.	5,700	5,700	5,700	6,200	6,200	7,900	7,900	7,900	7,900
Shipping Weight, approximate kg	2,586	2,586	2,586	2,812	2,812	3,583	3,583	3,583	3,583

Notes:

- A. Ratings shown for elevation to 2000 Feet @ 60HZ and uncontrolled emissions. For ratings above 2000 Feet, controlled emissions, and/or 50HZ, contact your local Cleaver-Brooks Representative as fan motor sizes will change.
- B. Steam ratings are for operating pressure of 10 psig and 125 psig with water at 180 F supply.
- C. Input calculated with Nat. Gas @ 1000 Btu/ft<sup>3</sup>, Propane @ 2500 Btu/ft<sup>3</sup>, and Oil @ 140,000Btu/gal.
- D. Standard Motors meet the requirements of UL & NEMA and include the following:

Open drip proof design	NEMA Design "B"
1.15 Service Factor	Ball Bearing
Class "B" Insulation	Continuous Duty, 40° C ambient

**Table 5: FLX Steam Ratings Sizes 600-1200**


Boiler SIZE	600	700	800	900	1000	1100	1200
<b>Ratings [Notes A and B]</b>							
Steam Capacity (lbs. steam/hr from & at 212° F.)	4,934	5,762	6,590	7,418	8,246	9,074	9,902
Steam Capacity [kg/hr from and at 100 C]	2,238	2,614	2,989	3,365	3,740	4,116	4,492
Output Btu/hr	4,786,925	5,590,325	6,393,725	7,197,125	8,000,525	8,803,925	9,607,325
Output Kcal/Hr	1,206,348	1,408,812	1,611,276	1,813,740	2,016,204	2,218,668	2,421,132
Output kW	1,403	1,638	1,874	2,109	2,345	2,580	2,816
Output Boiler Horsepower	143	167	191	215	239	263	287
<b>Approximate Fuel Consumption [ Input - Note C]</b>							
Natural Gas [ft <sup>3</sup> /hr] - 15 PSI Steam	5,802	6,776	7,893	8,885	9,877	10,869	11,861
Natural Gas Therms/Hour - 15 PSI Steam	58.0	67.8	78.9	88.9	98.8	108.7	118.6
Natural Gas [m <sup>3</sup> /hr] - 1.03 Bar Steam	164.3	191.9	223.5	251.6	279.7	307.8	335.9
Natural Gas [ft <sup>3</sup> /hr] - 150 PSI Steam	5,910	6,902	7,992	8,996	10,001	11,005	12,009
Natural Gas Therms/Hour - 150 PSI Steam	59.1	69.0	79.9	90.0	100.0	110.0	120.1
Natural Gas [m <sup>3</sup> /hr] - 10.34 Bar Steam	167.3	195.4	226.3	254.7	283.2	311.6	340.1
Propane Gas [ft <sup>3</sup> /hr] - 15 PSI Steam	2,321	2,710	3,157	3,490	3,951	4,348	4,744
Propane Gas [ft <sup>3</sup> /hr] - 150 PSI Steam	2,364	2,761	3,197	3,599	4,000	4,402	4,804
Propane Gas [m <sup>3</sup> /hr] - 1.03 Bar Steam	65.7	76.8	89.4	98.8	111.9	123.1	134.3
Propane Gas [m <sup>3</sup> /hr] - 10.34 Bar Steam	66.9	78.2	90.5	101.9	113.3	124.6	136.0
No.2 Oil Fuel - gph, 15 PSI Steam	41.4	48.4	55.4	62.3	69.3	76.2	83.2
No.2 Oil Fuel - gph, 150 PSI Steam	42.2	49.3	56.4	63.5	70.6	77.6	84.7
No.2 Oil Fuel - liters/hour, 1.03 Bar Steam	156.7	183.0	209.2	235.5	261.8	288.1	314.4
No.2 Oil Fuel - liters/hour, 10.34 Bar Steam	159.6	186.3	213.1	239.9	266.7	293.5	320.2
<b>Power Requirements - Uncontrolled Emissions [Notes A and D]</b>							
Blower Motor HP - Gas Firing	5	5	5	7.5	10	10	15
Blower Motor kW - Gas Firing	3.73	3.73	3.73	5.595	7.46	7.46	11.19
Blower Motor HP - Oil or Combination	5	5	5	7.5	10	10	10
Blower Motor kW - Oil or Combination	3.73	3.73	3.73	5.595	7.46	7.46	7.46
Oil Pump HP for Oil or Combination	0.75	0.75	1	1.5	1.5	1.5	1.5
Oil Pump kW for Oil or Combination	0.5595	0.5595	0.746	1.119	1.119	1.119	1.119
<b>Minimum Ampacity - Standard</b>							
Blower Motor - Gas, 230/3/60	15.2	15.2	15.2	22	28	28	42
Blower Motor - Oil or Combination, 230/3/60	15.2	15.2	15.2	22	28	28	42
Blower Motor - Gas, 460/3/60	7.6	7.6	7.6	11	14	14	17
Blower Motor - Oil or Combination, 460/3/60	7.6	7.6	7.6	11	14	14	17
Blower Motor - Gas, Oil or Combination, 400/3/50	8	8	8	12	16	16	16
Blower Motor - Gas, 575/3/60	6.1	6.1	6.1	9	11	11	17
Blower Motor - Oil or Combination, 575/3/60	6.1	6.1	6.1	9	11	11	17
Remote Oil Pump, [230]460/3/60	[3.2] 1.6	[3.2] 1.6	[4.2] 2.1	[6] 3	[6] 3	[6] 3	[6] 3
Remote Oil Pump, 575/3/60	1.3	1.3	1.7	2.4	2.4	2.4	2.4
Control Circuit @115/1/60	2.4	1.9	1.9	1.9	2.4	2.4	2.4
<b>Weights</b>							
Operating Weight, lbs.	9,200	12,500	12,500	12,500	14,100	14,100	14,100
Operating Weight, kg	4,173	5,670	5,670	5,670	6,396	6,396	6,396
Water Content Normal, gallons	157	277	277	277	289	289	289
Water Content Normal, liters	594	1,048	1,048	1,048	1,094	1,094	1,094
Water Content Flooded, gallons	293	464	464	464	562	562	562
Water Content Flooded, liters	1,109	1,756	1,756	1,756	2,127	2,127	2,127
Shipping Weight, approximate lbs	7,900	10,200	10,200	10,200	12,000	12,000	12,000
Shipping Weight, approximate kg	3,583	4,627	4,627	4,627	5,443	5,443	5,443

Notes:

- A. Ratings shown for elevation to 2000 Feet @ 60HZ and uncontrolled emissions. For ratings above 2000 Feet, controlled emissions, and/or 50HZ, contact your local Cleaver-Brooks Representative as fan motor sizes may change.
- B. Steam ratings are for operating pressure of 10 psig and 125 psig with water at 180 F supply.
- C. Input calculated with Nat. Gas @ 1000 Btu/ft<sup>3</sup>, Propane @ 2500 Btu/ft<sup>3</sup>, and Oil @ 140,000Btu/gal.
- D. Standard Motors meet the requirements of UL & NEMA and include the following:

Open drip proof design	NEMA Design "B"
1.15 Service Factor	Ball Bearing
Class "B" Insulation	Continuous Duty, 40° C ambient

**Figure 2: FLX HW Dimension Drawing**

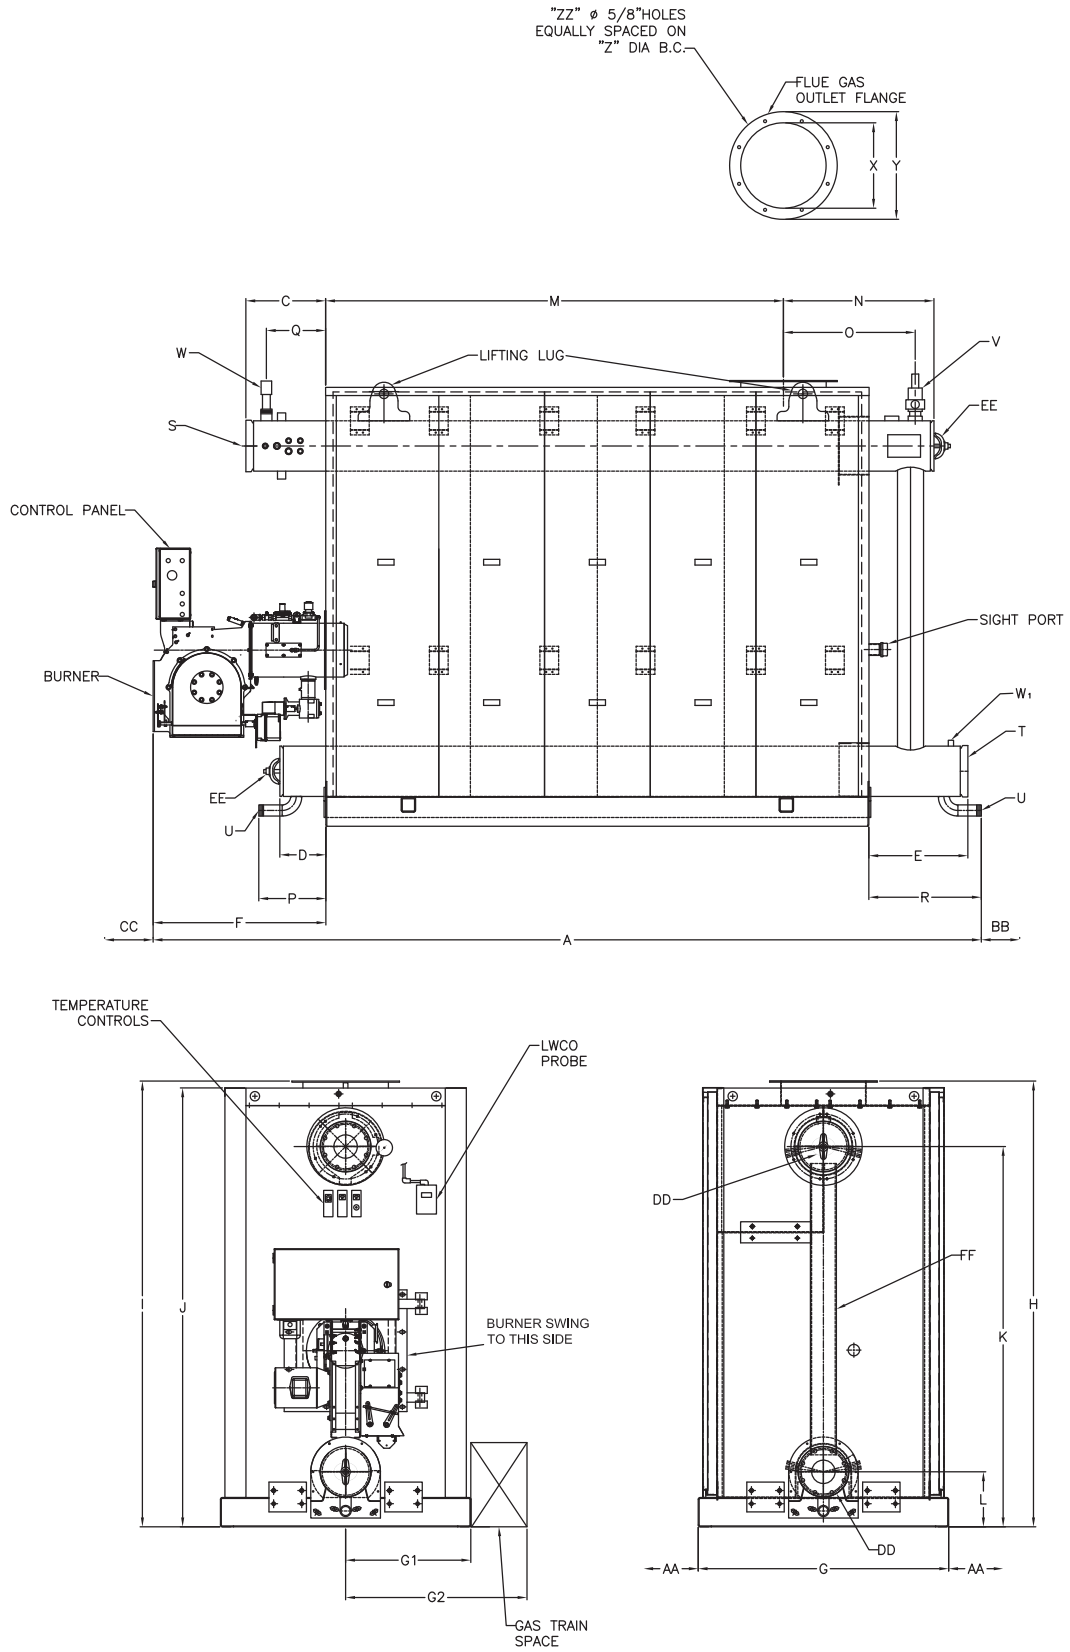

**Table 6: FLX HW Dimensions Sizes 150-500**

		BOILER SIZE [SEE NOTE 1]							
		150	200	250	300	350	400	450	500
<b>LENGTHS Inches</b>									
Overall Length of Boiler	<b>A</b>	115	115	115	120	120	146	146	146
Boiler Base Frame	<b>B</b>	68	68	68	74	74	95	95	95
Front Extension Upper	<b>C</b>	17	17	17	17	17	17	17	17
Front Extension Lower	<b>D</b>	11	11	11	11	11	11	11	11
Rear Extension Lower	<b>E</b>	20	20	20	20	20	21	21	21
Burner Extension	<b>F</b>	27	27	27	27	27	31	31	31
<b>WIDTHS Inches</b>									
Boiler Base Frame [Note	<b>G</b>	42	42	42	46	46	48	48	48
Centerline to Casing	<b>G<sub>1</sub></b>	21	21	21	23	23	24	24	24
Centerline to outside Gas	<b>G<sub>2</sub></b>	33	33	33	35	35	36	36	36
<b>HEIGHTS Inches</b>									
Base to Stack Flange	<b>H</b>	78	78	78	82	82	86	86	86
Base to Lifting Lug	<b>I</b>	78	78	78	82	82	86	86	86
Base to Top of Casing	<b>J</b>	76	76	76	80	80	85	85	85
Base to Supply Nozzle	<b>K</b>	65	65	65	69	69	73	73	73
Base to Return Nozzle	<b>L</b>	9	9	9	9	9	10	10	10
<b>LOCATIONS Inches</b>									
Flue Outlet Centerline	<b>M</b>	54	54	54	62	62	81	81	81
Rear Extension Upper	<b>N</b>	28	28	28	26	26	28	28	28
Safety Valves	<b>O</b>	24	24	24	22	22	24	24	24
Bottom Drain see Note 3	<b>P</b>	15	15	15	15	15	15	15	15
Boiler Air Vent	<b>Q</b>	12	12	12	13	13	13	13	13
Bottom Drain Rear see	<b>R</b>	N/A	N/A	N/A	N/A	N/A	24	24	24
<b>PIPING CONNECTIONS</b>									
Supply Nozzle [Note 4]	<b>S</b>	3 FLG	3 FLG	3 FLG	4 FLG	4 FLG	6 FLG	6 FLG	6 FLG
Return Nozzle [Note 4]	<b>T</b>	3 FLG	3 FLG	3 FLG	4 FLG	4 FLG	6 FLG	6 FLG	6 FLG
Bottom Drain see Note 2	<b>U</b>	1½	1½	1½	1½	1½	2 @ 2	2 @ 2	2 @ 2
Safety Valves, 30 psig	<b>V</b>	2	2	2	2	2	2½	2½	2½
Safety Valves, 60 psig	<b>V</b>	1½	1½	1½	1½	1½	2	2	2
Safety Valves, 125 psig	<b>V</b>	1	1	1	1¼	1¼	1½	1½	1½
Safety Valves, 160 psig	<b>V</b>	¾	¾	¾	¾	¾	1¼	1¼	1¼
Boiler Air Vent	<b>W</b>	1	1	1	1	1	1	1	1
Tapping for optional	<b>W<sub>1</sub></b>	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
Flue Gas ID	<b>X</b>	10	10	10	12	12	16	16	16
Flue Gas Outlet Flange	<b>Y</b>	15	15	15	17	17	21	21	21
Flange Bolt Circle	<b>Z</b>	12½	12½	12½	14½	14½	18½	18½	18½
Number of holes in bolt	<b>ZZ</b>	4	4	4	4	4	6	6	6
<b>MINIMUM SERVICE</b>									
Tube removal each side	<b>AA</b>	28	28	28	32	32	34	34	34
Rear service area	<b>BB</b>	24	24	24	24	24	24	24	24
Front service area -	<b>CC</b>	36	36	36	36	36	36	36	40
<b>PERIPHERAL DATA</b>									
Upper/Lower Drum OD	<b>DD</b>	8-5/8"	8-5/8"	8-5/8"	8-5/8"	8-5/8"	10-3/4"	10-3/4"	10-3/4"
Handhole Inspection	<b>EE</b>	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"
Rear Downcomer (NPS)	<b>FF</b>	4	4	4	4	4	5	5	5

- NOTES:**
1. For Btu/hr input rating, multiply model designation by 10,000.
  2. Add 4" to each side of the base frame dimension to account for optional seismic anchor pads.
  3. For Models 150 to 350 a single drain connection is provided at the front bottom drum; for Models 400 and greater, an additional drain
  4. Supply and return nozzle flanges are 150# Flat Face.
  5. Standard safety valve setting is 160 psig and options for reduced settings are noted.

**Table 7: FLX HW Dimensions Sizes 550-1200**

		BOILER SIZE [SEE NOTE 1]							
		550	600	700	800	900	1000	1100	1200
<b>LENGTHS Inches</b>									
Overall Length of Boiler	<b>A</b>	146	153	174	174	174	206	206	206
Boiler Base Frame	<b>B</b>	95	95	116	116	116	140	140	140
Front Extension Upper	<b>C</b>	17	17	17	17	17	17	17	17
Front Extension Lower	<b>D</b>	11	11	11	11	11	12	12	12
Rear Extension Lower	<b>E</b>	21	21	21	21	21	22	22	22
Burner Extension	<b>F</b>	31	37	37	37	37	44	44	44
<b>WIDTHS Inches</b>									
Boiler Base Frame [Note	<b>G</b>	48	48	54	54	54	54	54	54
Centerline to Casing	<b>G<sub>1</sub></b>	24	24	27	27	27	27	27	27
Centerline to outside Gas	<b>G<sub>2</sub></b>	36	36	39	39	39	39	39	39
<b>HEIGHTS Inches</b>									
Base to Stack Flange	<b>H</b>	86	86	95	95	95	95	95	95
Base to Lifting Lug	<b>I</b>	86	86	95	95	95	95	95	95
Base to Top of Casing	<b>J</b>	85	85	94	94	94	94	94	94
Base to Supply Nozzle	<b>K</b>	73	73	81	81	81	81	81	81
Base to Return Nozzle	<b>L</b>	10	10	10	10	10	12	12	12
<b>LOCATIONS Inches</b>									
Flue Outlet Centerline	<b>M</b>	81	81	102	102	102	122	122	122
Rear Extension Upper	<b>N</b>	28	28	28	28	28	33	33	33
Safety Valves	<b>O</b>	24	24	24	24	24	29	29	29
Bottom Drain see Note 3	<b>P</b>	15	15	15	15	15	15	15	15
Boiler Air Vent	<b>Q</b>	13	13	13	13	13	7	7	7
Bottom Drain Rear see	<b>R</b>	24	24	24	24	24	19	19	19
<b>PIPING CONNECTIONS</b>									
Supply Nozzle [Note 4]	<b>S</b>	6 FLG	6 FLG	6 FLG	6 FLG	6 FLG	8 FLG	8 FLG	8 FLG
Return Nozzle [Note 4]	<b>T</b>	6 FLG	6 FLG	6 FLG	6 FLG	6 FLG	8 FLG	8 FLG	8 FLG
Bottom Drain see Note 2	<b>U</b>	2 @ 2	2 @ 2	2 @ 2	2 @ 2	2 @ 2	2 @ 2	2 @ 2	2 @ 2
Safety Valves, 30 psig	<b>V</b>	2½	2½	2 @ 2½	2 @ 2½	2 @ 2½	2 @ 2½	2 @ 2½	2 @ 2½
Safety Valves, 60 psig	<b>V</b>	2	2	2½	2½	2½	2½	2½	2½
Safety Valves, 125 psig	<b>V</b>	1½	1½	1½	1½	1½	1½	1½	1½
Safety Valves, 160 psig	<b>V</b>	1¼	1¼	1½	1½	1½	1½	1½	1½
Boiler Air Vent	<b>W</b>	1	1	1	1	1	1	1	1
Tapping for optional	<b>W<sub>1</sub></b>	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
Flue Gas ID	<b>X</b>	16	16	18	18	18	24	24	24
Flue Gas Outlet Flange	<b>Y</b>	21	21	23	23	23	29	29	29
Flange Bolt Circle	<b>Z</b>	18½	18½	20½	20½	20½	26½	26½	26½
Number of holes in bolt	<b>ZZ</b>	6	6	8	8	8	8	8	8
<b>MINIMUM SERVICE</b>									
Tube removal each side	<b>AA</b>	34	34	40	40	40	40	40	40
Rear service area	<b>BB</b>	24	24	24	24	24	24	24	24
Front service area -	<b>CC</b>	40	40	40	40	45	45	45	45
<b>PERIPHERAL DATA</b>									
Upper/Lower Drum OD	<b>DD</b>	10-3/4"	10-3/4"	10-3/4"	10-3/4"	10-3/4"	10-3/4"	10-3/4"	10-3/4"
Handhole Inspection	<b>EE</b>	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"	4" x 5"
Rear Downcomer (NPS)	<b>FF</b>	5	5	5	5	5	5	5	5

- NOTES:**
1. For Btu/hr input rating, multiply model designation by 10,000.
  2. Add 4" to each side of the base frame dimension to account for optional seismic anchor pads.
  3. For Models 150 to 350 a single drain connection is provided at the front bottom drum; for Models 400 and greater, an additional drain
  4. Supply and return nozzle flanges are 150# Flat Face.
  5. Standard safety valve setting is 160 psig and options for reduced settings are noted.

**Table 8: FLX HW Ratings Sizes 150-550**

Boiler SIZE	150	200	250	300	350	400	450	500	550
<b>Ratings [Notes A and B]</b>									
Output Btu/hr	1,205,100	1,606,800	2,008,500	2,410,200	2,811,900	3,213,600	3,615,300	3,983,525	4,385,225
Output Kcal/Hr	303,696	404,928	506,160	607,392	708,624	809,856	911,088	1,003,884	1,105,116
Output kW	353	471	589	706	824	942	1,060	1,168	1,285
Output Boiler Horsepower	36	48	60	72	84	96	108	119	131
<b>Approximate Fuel Consumption [Input - Note C]</b>									
Natural Gas [ft <sup>3</sup> /hr] - 180 F Supply Water	1,435	1,936	2,420	2,904	3,388	3,826	4,304	4,742	5,221
Natural Gas Therms/Hour - 180 F Supply Water	14.3	19.4	24.2	29.0	33.9	38.3	43.0	47.4	52.2
Natural Gas [m <sup>3</sup> /hr] - 82C Water Supply	40.6	54.8	68.5	82.2	95.9	108.3	121.9	134.3	147.8
Propane Gas [ft <sup>3</sup> /hr] - 180 F Supply Water	574	774	968	1,162	1,355	1,530	1,722	1,897	2,088
Propane Gas [m <sup>3</sup> /hr] - 82C Water Supply	16.2	21.9	27.4	32.9	38.4	43.3	48.8	53.7	59.1
No.2 Oil Fuel - gph, 180 F Supply Water	10.4	13.9	17.4	20.9	24.3	27.8	31.3	34.5	38.0
No.2 Oil Fuel - liters/hour, 82C Water Supply	39.4	52.6	65.7	78.9	92.0	105.2	118.3	130.4	143.5
<b>Power Requirements - Uncontrolled Emissions [Notes A and D]</b>									
Blower Motor HP - Gas Firing	1/2	3/4	3/4	3/4	1	1	2	2	3
Blower Motor kW - Gas Firing	0.378	0.5595	.5595	.5595	0.746	0.746	1.492	1.492	2.238
Blower Motor HP - Oil or Combination	3/4	1	1	1	1-1/2	1-1/2	2	3	3
Blower Motor kW - Oil or Combination	.5595	0.746	0.746	0.746	1.119	1.119	1.492	2.238	2.238
Oil Pump for Oil or Combination	Direct Drive from the Blower Motor								
<b>Minimum Ampacity - Standard</b>									
Blower Motor - Gas Firing Only, [115]230/1/60	[9.8] 4.9	[13.8] 6.9	[13.8] 6.9	[13.8] 6.9	[16] 8	[16] 8	[24] 12		
Blower Motor - Oil or Combination, [115]230/1/60	[13.8] 6.9	[16] 8	[16] 8	[16] 8	[20] 10	[20] 10	[24] 12		
Blower Motor - Gas, 230/3/60								6.8	9.6
Blower Motor - Oil or Combination, 230/3/60								9.6	9.6
Blower Motor - Gas, 460/3/60								3.4	4.8
Blower Motor - Oil or Combination, 460/3/60								4.8	4.8
Blower Motor - Gas, Oil or Combination, 400/3/50								2.8	4.2
Blower Motor - Gas, 575/3/60								2.7	3.9
Blower Motor - Oil or Combination, 575/3/60								3.9	3.9
Remote Oil Pump, [230]460/3/60									
Control Circuit @115/1/60	1.7	1.7	1.7	1.9	1.9	1.9	2.4	2.4	2.4
<b>Weights</b>									
Operating Weight, lbs.	4,700	4,700	4,700	5,900	5,900	7,600	7,600	7,600	7,600
Operating Weight, kg	2,132	2,132	2,132	2,676	2,676	3,447	3,447	3,447	3,447
Water Content Normal, gallons	96	96	96	108	108	180	180	180	180
Water Content Normal, liters	363	363	363	409	409	681	681	681	681
Water Content Flooded, gallons	96	96	96	108	108	180	180	180	180
Water Content Flooded, liters	363	363	363	409	409	681	681	681	681
Shipping Weight, approximate lbs.	3,900	3,900	3,900	5,000	5,000	6,100	6,100	6,100	6,100
Shipping Weight, approximate kg	1,769	1,769	1,769	2,268	2,268	2,767	2,767	2,767	2,767

Notes:

A. Ratings shown for elevation to 1000 Feet. For ratings above 1000 Feet, contact your local Cleaver-Brooks Representative.

B. Input calculated with Nat. Gas @ 1000 Btu/ft<sup>3</sup>, Propane @ 2500 Btu/ft<sup>3</sup>, and Oil @ 140,000Btu/gal.

C. Standard Motors meet the requirements of UL & NEMA and include the following:

- |                        |  |
|------------------------|--|
| Open drip proof design | NEMA Design "B"                            |
| 1.15 Service Factor    | Ball Bearing                               |
| Class "B" Insulation   | Continuous Duty, 40 <sup>o</sup> C ambient |

October, 2015

**Table 9: FLX HW Ratings Sizes 600-1200**

<b>Boiler SIZE</b>	<b>600</b>	<b>700</b>	<b>800</b>	<b>900</b>	<b>1000</b>	<b>1100</b>	<b>1200</b>
<b>Ratings [Notes A and B]</b>							
Output Btu/hr	4,786,925	5,590,325	6,393,725	7,197,125	8,000,525	8,803,925	9,607,325
Output Kcal/Hr	1,206,348	1,408,812	1,611,276	1,813,740	2,016,204	2,218,668	2,421,132
Output kW	1,403	1,638	1,874	2,109	2,345	2,580	2,816
Output Boiler Horsepower	143	167	191	215	239	263	287
<b>Approximate Fuel Consumption [ Input - Note B]</b>							
Natural Gas [ft <sup>3</sup> /hr] - 180 F Supply Water	5,699	6,735	7,703	8,671	9,639	10,607	11,575
Natural Gas Therms/Hour - 180 F Supply Water	57.0	67.4	77.0	86.7	96.4	106.1	115.8
Natural Gas [m <sup>3</sup> /hr] - 82C Water Supply	161.4	190.7	218.1	245.5	272.9	300.4	327.8
Propane Gas [ft <sup>3</sup> /hr] - 180 F Supply Water	2,279	2,694	3,081	3,468	3,856	4,243	4,630
Propane Gas [m <sup>3</sup> /hr] - 82C Water Supply	64.5	76.3	87.2	98.2	109.2	120.1	131.1
No.2 Oil Fuel - gph, 180 F Supply Water	40.7	47.0	53.7	60.5	68.0	74.9	81.7
No.2 Oil Fuel - liters/hour, 82C Water Supply	153.9	177.6	203.1	228.6	257.2	283.0	308.8
<b>Power Requirements - Uncontrolled Emissions [Notes A and C]</b>							
Blower Motor HP - Gas Firing	5	5	5	7.5	10	10	15
Blower Motor kW - Gas Firing	3.73	3.73	3.73	5.595	7.46	7.46	11.19
Blower Motor HP - Oil or Combination	5	5	5	7.5	10	10	15
Blower Motor kW - Oil or Combination	3.73	3.73	3.73	5.595	7.46	7.46	11.19
Oil Pump for Oil or Combination	0.75	0.75	1	1.5	1.5	1.5	1.5
Oil Pump for Oil or Combination	0.5595	0.5595	0.746	1.119	1.119	1.119	1.119
<b>Minimum Ampacity - Standard</b>							
Blower Motor - Gas, 230/3/60	15.2	15.2	15.2	22	28	28	42
Blower Motor - Oil or Combination, 230/3/60	15.2	15.2	15.2	22	28	28	42
Blower Motor - Gas, 460/3/60	7.6	7.6	7.6	11	14	14	17
Blower Motor - Oil or Combination, 460/3/60	7.6	7.6	7.6	11	14	14	17
Blower Motor - Gas, Oil or Combination, 400/3/50	8	8	8	12	16	16	16
Blower Motor - Gas, 575/3/60	6.1	6.1	6.1	9	11	11	17
Blower Motor - Oil or Combination, 575/3/60	6.1	6.1	6.1	9	11	11	17
Remote Oil Pump, [230]460/3/60	[3.2] 1.6	[3.2] 1.6	[4.2] 2.1	[6] 3	[6] 3	[6] 3	[6] 3
Remote Oil Pump, 575/3/60	1.3	1.3	1.7	2.4	2.4	2.4	2.4
Control Circuit @115/1/60	1.7	1.7	1.7	1.9	1.9	1.9	2.4
<b>Weights</b>							
Operating Weight, lbs.	7,600	10,500	10,500	10,500	12,300	12,300	12,300
Operating Weight, kg	3,447	4,763	4,763	4,763	5,579	5,579	5,579
Water Content Normal, gallons	180	240	240	240	276	276	276
Water Content Normal, liters	681	908	908	908	1,045	1,045	1,045
Water Content Flooded, gallons	180	240	240	240	276	276	276
Water Content Flooded, liters	681	908	908	908	1045	1045	1045
Shipping Weight, approximate lbs.	6,100	8,500	8,500	8,500	10,000	10,000	10,000
Shipping Weight, approximate kg	2,767	3,856	3,856	3,856	4,536	4,536	4,536

Notes:

A. Ratings shown for elevation to 1000 Feet. For ratings above 1000 Feet, contact your local Cleaver-Brooks Representative.

B. Input calculated with Nat. Gas @ 1000 Btu/ft<sup>3</sup>, Propane @ 2500 Btu/ft<sup>3</sup>, and Oil @ 140,000Btu/gal.

C. Standard Motors meet the requirements of UL & NEMA and include the following:

Open drip proof design  
1.15 Service Factor  
Class "B" Insulation

NEMA Design "B"  
Ball Bearing  
Continuous Duty, 40<sup>0</sup> C ambient

October, 2015



## PERFORMANCE DATA

### Efficiency

Fuel-to-steam (fuel-to-water) efficiency is based on specific operating conditions (fuel, pressure, temperature). Nominal efficiency on all FLX hot water and low pressure steam boilers is 81% firing natural gas, and 84% firing No. 2 oil. For high pressure steam applications, contact your local Cleaver-Brooks representative for expected efficiencies.

### Emissions

Expected emissions for natural gas fired FLX boilers are shown in Table 10.

**Table 10: Expected emissions (ppm, corrected to 3% O<sub>2</sub>), natural gas fired boiler**

FLUE GAS COMPONENT	HIGH-FIRE LEVEL <sup>A</sup> PPM <sub>v</sub>	LOW-FIRE LEVEL <sup>B</sup> PPM <sub>v</sub>
CO	<100	<100
NO <sub>x</sub>	≥70	≥70

NOTE: NO<sub>x</sub> levels based on standard product offering.

A. Based on 12% excess air.

B. Based on 15% excess air.

## ENGINEERING DATA

### Flow Rates and Pressure Drops

Flow rates and pressure drops for the FLX hot water boilers are shown in Table 11. This table can be used to determine the boiler pressure drop in relation to full boiler output and system temperature drop.

Table 12 can be used to determine the maximum gpm circulating rate in relation to full boiler output and system temperature drop. The maximum gpm can be determined by knowing the boiler size and expected system temperature drop.

**Table 11: Model FLX Hot Water Boiler Flow Rates and Pressure Drops**

MODEL NO.	$\Delta T = 20^{\circ}F$		$\Delta T = 40^{\circ}F$		$\Delta T = 60^{\circ}F$		$\Delta T = 80^{\circ}F$		$\Delta T = 100^{\circ}F$	
	$\Delta P$ (PSIG)	GPM	$\Delta P$ (PSIG)	GPM	$\Delta P$ (PSIG)	GPM	$\Delta P$ (PSIG)	GPM	$\Delta P$ (PSIG)	GPM
FLX-150	1.14	122.0	0.30	61.1	0.13	41.1	0.08	30.8	0.05	24.4
FLX-200	1.14	162.3	0.30	81.1	0.13	54.1	0.08	40.6	0.05	32.5
FLX-250	1.77	202.8	0.46	101.4	0.21	67.6	0.12	50.7	0.08	40.6
FLX-300	1.85	243.4	0.48	121.7	0.22	81.1	0.12	60.9	0.08	48.7
FLX-350	2.49	284.0	0.65	142.0	0.29	94.7	0.17	71.0	0.11	56.8
FLX-400	1.35	324.5	0.35	162.3	0.16	108.2	0.09	81.1	0.06	64.9
FLX-450	1.71	365.1	0.44	182.6	0.20	121.7	0.11	91.2	0.08	73.0
FLX-500	2.03	405.7	0.54	202.8	0.25	135.2	0.14	101.4	0.09	81.1
FLX-550	2.50	446.3	0.67	223.1	0.31	148.7	0.17	111.5	0.11	89.2
FLX-600	2.99	486.8	0.77	243.4	0.35	162.3	0.20	121.7	0.13	97.4
FLX-700	1.75	567.9	0.45	284.0	0.21	189.3	0.12	142.0	0.08	113.6
FLX-800	2.27	649.1	0.59	324.5	0.27	216.4	0.15	162.3	0.10	129.8
FLX-900	2.85	730.2	0.74	365.1	0.33	243.4	0.19	182.6	0.12	146.0
FLX-1000	4.08	811.4	1.02	405.6	0.42	270.4	0.25	202.8	0.15	163.6
FLX-1100	4.42	892.6	1.15	446.2	0.48	297.4	0.28	223.0	0.18	178.4
FLX-1200	6.20	973.6	1.60	486.8	0.59	324.6	0.31	243.4	0.22	194.8

**Table 12: Model FLX Circulating Rates, Hot Water Boiler**

MODEL NO. (HP)	SYSTEM TEMPERATURE DROP °F									
	10	20	30	40	50	60	70	80	90	100
	MAXIMUM CIRCULATING RATE - GPM									
FLX-150 (36)	243	122	81	61	49	41	35	31	27	24
FLX-200 (48)	324	162	108	81	65	54	46	41	36	32
FLX-250 (60)	404	202	135	101	81	68	58	51	45	41
FLX-300(72)	488	244	162	122	97	81	70	61	54	49
FLX-350 (84)	568	284	189	142	114	95	81	71	63	57
FLX-400 (96)	648	324	216	162	130	108	93	81	72	65
FLX-450 (108)	729	365	243	182	146	122	105	91	81	73
FLX-500 (119)	812	406	270	203	162	135	116	101	90	81
FLX-550 (131)	893	447	297	223	178	149	128	111	99	89
FLX-600 (143)	972	486	325	243	195	162	139	122	108	97
FLX-700 (167)	1136	568	379	284	227	189	162	142	126	114
FLX-800 (191)	1300	650	433	325	260	216	185	162	144	130
FLX-900 (215)	1460	730	487	365	292	243	209	183	162	146
FLX-1000 (239)	1622	811	541	406	324	270	232	203	180	164
FLX-1100 (263)	1784	893	595	446	357	297	255	223	198	178
FLX-1200 (287)	1947	974	649	487	389	325	279	243	216	195

**System Operating Parameters (Hot Water)**

System over pressure requirements are shown in Table 13.

Minimum return water temperature is 140 °F; minimum supply (boiler outlet) water temperature is 150 °F in order to prevent fireside corrosion.

**Table 13: Model FLX Minimum Over Pressure Requirements**

MAX. OUTLET TEMPERATURE (°F)	MIN. SYSTEM PRESSURE (PSIG)
180	12
190	15
200	18
210	21
220	24
230	27
240	30

**System Operating Parameters (Steam Boilers)**

The following operating limitations must be observed for optimum operation of the boiler:

1. Minimum make-up temperature 60 °F.
2. Maximum make-up rate (for on/off make-up control) 2.0 times the evaporation rate.
3. Minimum operating pressure 6 psig. on low pressure steam and 40 psig. on high pressure steam.
4. Maximum operating pressure 12 psig. on low pressure steam.
5. Maximum load tracking rate 0 - 100% load or 100% - 0 load, 30 seconds on low pressure steam and 20% per minute on high pressure steam.

Maximum boiler water chemistry parameters: Silica: 150 ppm; specific conductance: 3500  $\mu$ mho/cm un-neutralized; total alkalinity: 300 ppm as CaCO<sub>3</sub>; hardness: 0; oxygen: 7 ppb; pH: 7 - 10; total iron: 0.05 ppm; oil matter: 1 ppm.

**Boiler Heat Release Information**

Boiler heat release information is shown in Table 14.

**Table 14: Model FLX Boiler Heat Release Information**


MODEL NO.	FURNACE PROJECTED AREA (FT <sup>2</sup> )	FURNACE VOLUME (FT <sup>3</sup> )	FURNACE HEAT RELEASE BTU/HR (FT <sup>3</sup> )	FURNACE HEAT RELEASE BTU/HR (FT <sup>2</sup> )
FLX-150	38.4	24.2	61,983	39,063
FLX-200	38.4	24.2	82,645	52,083
FLX-250	38.4	24.2	103,306	65,104
FLX-300	48.7	34.9	85,960	61,602
FLX-350	48.7	34.9	100,287	71,869
FLX-400	70.6	54.7	73,126	56,657
FLX-450	70.6	54.7	82,267	63,739
FLX-500	70.6	54.7	91,408	70,822
FLX-550	70.6	54.7	100,548	77,904
FLX-600	70.6	54.7	109,689	84,986
FLX-700	104.6	94.6	73,996	66,922
FLX-800	104.6	94.6	84,567	76,482
FLX-900	104.6	94.6	95,137	86,042
FLX-1000	128.9	116.5	85,837	77,580
FLX-1100	128.9	116.5	94,421	85,337
FLX-1200	128.9	116.5	103,004	93,095

**Tube Attachment**

Construction of the Flexible Watertube Boiler includes a special tube-to-drum attachment that requires no welding or rolling (see Figure 3). The tube is fitted with a tapered ferrule, which is press-fit into the tube hole in the drum. The ferrule is welded to the tube at the factory for both new and replacement tubes, so no field welding is required. The tube is held in place with a keeper plate.

This tube attachment design reduces repair and maintenance costs, and also reduces the cost of field erection of new units.

**Figure 3: Model FLX Tube Attachment**

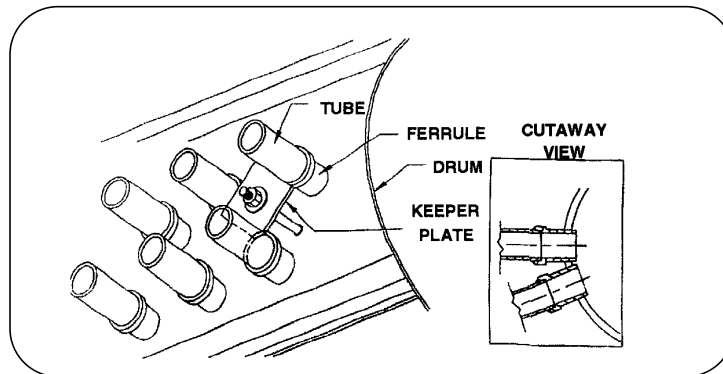

**Burner Characteristics**

Burner information is shown in Table 15. Note that the model selection may vary for actual application factors (altitude, gas pressure, etc.).

**Table 15: Model FLX Burner Characteristics**

MODEL NO.	BURNER MAXIMUM INPUT MBH	BURNER MODEL	FAN MOTOR (3450 RPM) VOLTAGE
FLX-150	1500	PFVLG-15	115/230/1/60
FLX-200	2000	PFVLG-20	115/230/1/60
FLX-250	2500	PFVLG-25	115/230/1/60
FLX-300	3000	PFVLG-30	115/230/1/60
FLX-350	3500	PFVLG-35	208/230/1/60
FLX-400	4000	PFVLG-40	208/230/1/60
FLX-450	4500	PFVLG-45	208-230/460/3/60
FLX-500	5000	PFVLG-50	230/460/3/60
FLX-550	5500	PFVLG-55	230/460/3/60
FLX-600	6000	PFVLG-60	460/3/60
FLX-700	7000	PFVLG-70	460/3/60
FLX-800	8000	PFVLG-80	460/3/60
FLX-900	9000	PFVLG-90	460/3/60
FLX-1000	10000	PFVLG-100	460/3/60
FLX-1100	11000	PFVLG-110	460/3/60
FLX-1200	12000	PFVLG-120	460/3/60

**Notes:**

1 Burner model selection shown is subject to changed and is based on actual application (altitude, gas pressure, reduced NOx, etc.)

2 Standard voltage for Canadian applications is 575/3/60.

3 Burner operation is Full Modulation on Elite Series and for the Econo series Low High Low for units 150 - 600 and modulated firing on 700 and greater.

4 Burner models shown are for combination gas/oil firing. For straight gas, delete the letter L, and for straight oil, delete the letter G.

### **Minimum Required Gas Pressures**

Approximate gas pressure required at rated input is shown in Table 16. For oversized gas trains or altitudes above 1,000 feet, contact your local Cleaver-Brooks authorized representative.

**Table 16: Model FLX Minimum Required Gas Pressure**

MODEL NO.	STD GAS TRAIN SIZE (IN.) Note 3	MIN. GAS PRESSURE (IN.W.C.) Note 4	MIN. GAS PRESSURE (IN.W.C.) Note 5	BURNER MODEL
FLX-150	1	11.2	12.5	PFVG-15
FLX-200	1	19.4	21.7	PFVG-20
FLX-250	1.5	12.4	15.7	PFVG-25
FLX-300	1.5	15.9	20.7	PFVG-30
FLX-350	1.5	15.5	22.0	PFVG-35
FLX-400	1.5	18.7	27.2	PFVG-40
FLX-450	2	16.0	26.7	PFVG-45
FLX-500	2	17.6	21.0	PFVG-50
FLX-550	2	22.9	27.1	PFVG-55
FLX-600	2	20.0	24.9	PFVG-60
FLX-700	2	25.2	31.9	PFVG-70
FLX-800	2.5	19.9	22.2	PFVG-80
FLX-900	2.5	24.7	27.7	PFVG-90
FLX-1000	2.5	31.6	31.6	PFVG-100
FLX-1100	2.5	37.3	37.3	PFVG-110
FLX-1200	2.5	38.2	38.2	PFVG-120

Notes:

1. Table is based on 1,000 Btu/cu.ft natural gas and elevation to 1000 feet.
2. Minimum gas pressure also applies to 200 fuel series.
3. As an option, the standard gas train can be replaced with an oversized design to reduce inlet gas pressure requirements.
4. Use this column for all U.S. Installations.
5. Use this column for all Canadian Installations.

### **Fuel Connections - Gas**


The local gas company should be consulted for requirements and authorization for installation and inspection of gas supply piping. Installation of gas supply piping and venting must be in accordance with all applicable engineering guidelines and regulatory codes. All connections made to the boiler should be arranged so that all components remain accessible for inspection, cleaning and maintenance.

A drip leg should be installed in the supply piping before the connection to the gas pressure regulator. The drip leg should be at least as large as the inlet fitting supplied with the boiler. Consideration must be given to both volume and pressure requirements when choosing gas supply piping size. Refer to the boiler dimension diagram provided by Cleaver-Brooks for the particular installation. Connections to the burner gas train should be made with a union, so that gas train components or the burner may be easily disconnected for inspection or service. Upon completion of the gas piping installation, the system should be checked for gas leakage and tight shutoff of all valves.

### **Fuel Connections - Oil**

Oil-fired burners are equipped with an oil pump, which draws fuel from a storage tank and supplies pressurized oil to the burner nozzle(s). The burner supply oil pump has a greater capacity than the burner requires for the maximum firing rate. Fuel not delivered to the nozzle is returned to the storage tank. A two-pipe (supply and return) oil system is recommended for all installations. Figure 4 shows a typical fuel oil supply arrangement. Oil lines must be sized for the burner and burner supply oil pump capacities.

Figure 4: Model FLX Oil Burner Supply Pump Installation

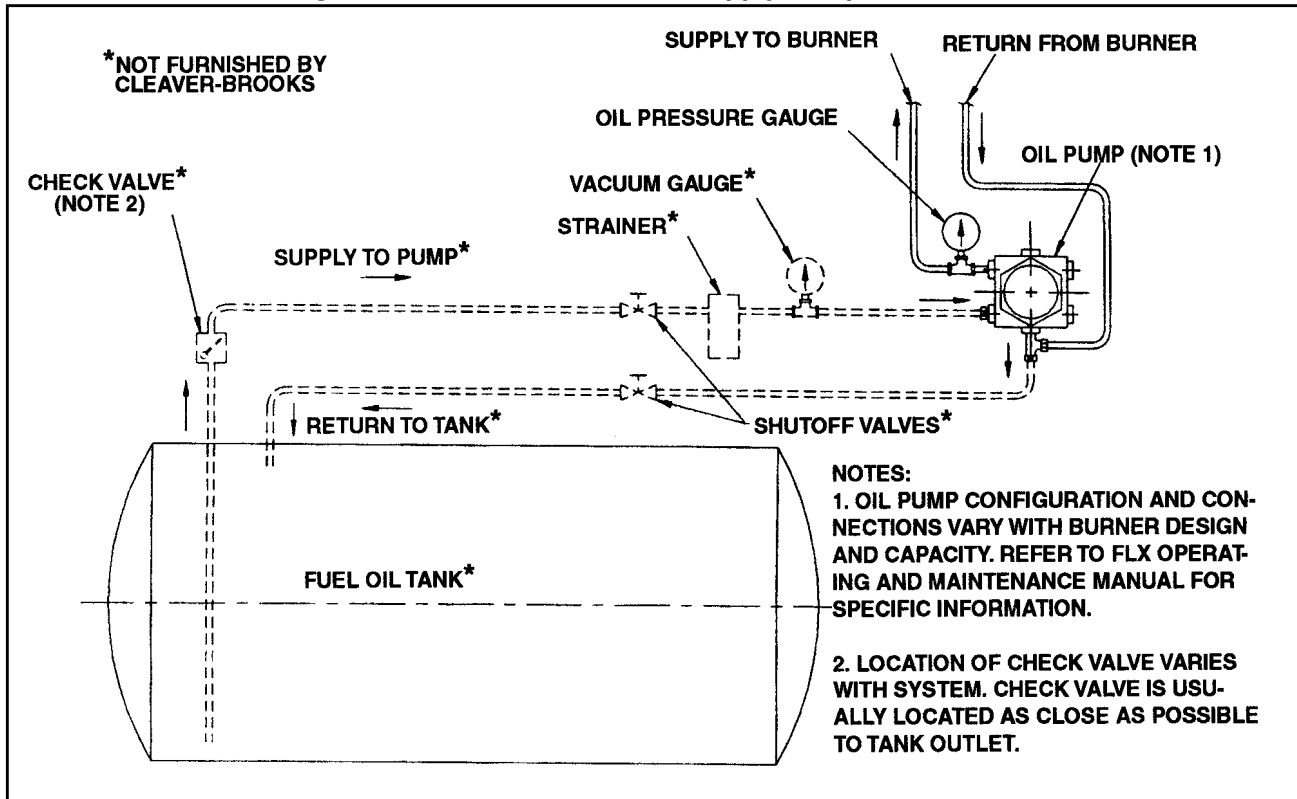

The burner supply oil pump suction should not exceed 10" Hg. If a transfer pump is used, it must have a pumping capacity at least equal to that of the burner pump(s). Supply pressure to the burner pump should not exceed 3 psig.

A strainer must be installed in the supply piping upstream of the burner supply pump in order to prevent entry of foreign material into the pump, fuel control valves, or burner nozzle(s). The strainer must be sized for the burner supply pump capacity. A strainer mesh of 150 microns (0.005") is recommended.

Install a check valve in the line to prevent draining of the oil suction line when the burner is not in operation. Location of the check valve varies with the system, but usually it is located as close as possible to the storage tank.

Installation of a vacuum gauge in the burner supply line between the burner oil pump and the strainer is recommended. Regular observation and recording of the gauge indication will assist in determining when the strainer needs servicing.

Upon completion of the oil piping installation, the system should be checked for oil or air leakage and for tight shutoff of all valves.

**Sound Levels****Table 17: Model FLX Sound Levels dBA**

FIRING RATE	MODEL NO.															
	150	200	250	300	350	400	450	500	550	600	700	800	900	1000	1100	1200
Low Fire (dBA)	75	75	76	75	75	77	78	79	79	79	81	81	83	79	82	85
High Fire (dBA)	76	76	77	76	76	78	79	80	80	80	82	82	83	81	83	86

Measurement: Three feet from front center of boiler, and 3-1/2 feet above boiler base. Measurements are decibel ratings on the A-weighted scale, registered without addition of sound attenuators, mufflers, or silencers. Sound pressure data taken on combination fuel burners firing oil. Sound pressure levels firing natural gas will be 0.5 dBA lower.

**Boiler Room Information**

The boiler must be installed on a non-combustible floor. If the floor is not level, piers, or a raised pad, slightly larger in length and width than the boiler base dimensions, will make boiler installations and leveling easier. Installation on a raised pad or piers will make boiler drain connections more accessible. The floor, pad, or piers must be of sufficient load bearing strength to safely support the operating weight of the boiler and any additional equipment installed with it. Approximate operating weights for Model FLX series steam and hot water boilers are shown in Dimensions and Ratings.

After the boiler is in place it must be leveled. Both side-to-side and front-to-back level can be verified using the vertical connection between the upper and lower drums at the back of the boiler. If shims are required to level the boiler, the weight of the boiler must be evenly distributed at all points of support.

The boiler must be installed so that all components remain accessible for inspection, cleaning, or maintenance. Field-installed piping and electrical connections to the burner and boiler must be arranged to allow removal of the casing panels, and swinging of the burner.

Minimum clearances to walls or other obstructions and combustible materials are shown in Figure 5. The top view shows areas that must be kept clear of field installed connections to the boiler for access or maintenance purposes.

A positive means of supplying a volume of outside air for complete fuel combustion is required. Proper ventilation of the boiler room must be provided. The amount of air required, and the required duct and air supply opening areas, are determined by the maximum fuel input rating of the burner and the altitude of the installation. Refer to Table 18. Air inlets must be sized in accordance with applicable engineering guidelines and regulatory code.

**Outdoor Reset Control**

Cleaver-Brooks does not recommend the use of outdoor controls which reset the boiler water outlet temperature below 150 °F, or the utilization of the boiler as a system thermostat.


**Breechings**

For single boiler installations, use breeching of the same diameter as the vent outlet on the boiler. For multiple boiler installations, and when a number of boilers of the same size (input) are to be connected to a common breeching, sections should be sized appropriately to accommodate the total flue gas volume.

**Stack Support Capabilities**


Flextube boilers can support up to 200 lbs without additional support.

Figure 5: Model FLX Clearance Requirements

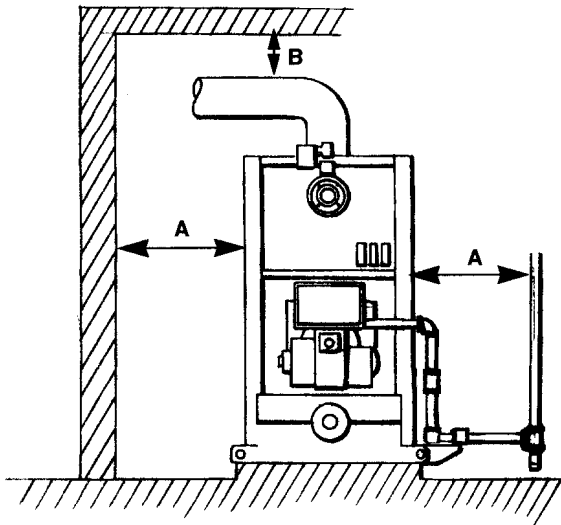

MODEL NO.	SIDES A	TOP B	FRONT C	REAR D
FLX-150 - 250	28	18	48	24
FLX-300 - 350	32	18	48	24
FLX-400 - 600	34	18	60	24
FLX-700 - 1200	40	18	60	24

NOTE: Top Dimension from boiler to top of stack based on stack selection.

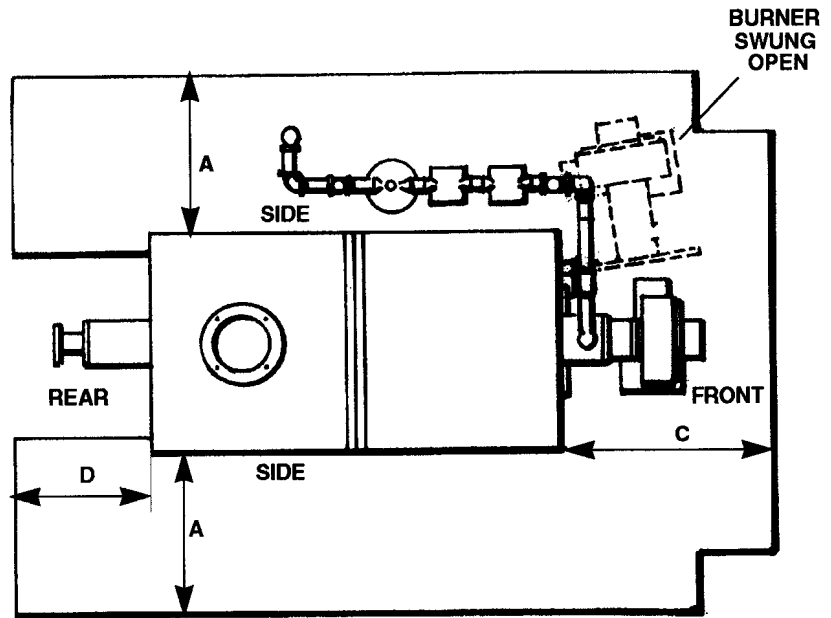




**Table 18: Combustion Air Requirements**

MODEL NO.		150	200	250	300	350	400	450	500	550	600	700	800	900	1000	1100	1200
Comb Air (Dry)	Gas (scfh)	15480	20640	25800	30960	36120	41280	46440	51600	56760	61920	72240	82560	92280	103200	113520	123840
	(lb/hr)	1207	1609	2012	2414	2817	3219	3621	4024	4426	4828	5633	6438	7243	8048	8853	9657
	Oil (scfh)	17050	22733	28414	34098	39782	45463	51146	56831	62514	68196	79562	90928	102294	113662	125028	136394
	(lb/hr)	1269	1692	2115	2538	2961	3384	3807	4231	4654	5077	5923	6769	7640	8462	9308	10154
Flue Gas (Dry)	Gas (scfh)	17520	23360	29200	35040	40880	46720	52560	58400	64240	70080	81760	93440	105120	116800	128480	140160
	(lb/hr)	1278	1704	2130	2556	2983	3409	3835	4261	4687	5113	5965	6817	7669	8521	9373	10225
	Oil (scfh)	17915	23886	29855	35827	41799	47769	53740	59713	65684	71655	83598	95541	107484	119427	131370	143312
	(lb/hr)	1357	1809	2261	2714	3166	3618	4070	4523	4975	5427	6330	7237	8142	9047	9951	10856

NOTES:

1. Natural gas @ 1000 Btu/cu-ft.
2. No. 2 oil @ 140,000 Btu/gal.

**Figure 6: Model FLX Breeching Arrangement - Single or Multiple Boiler Installation**

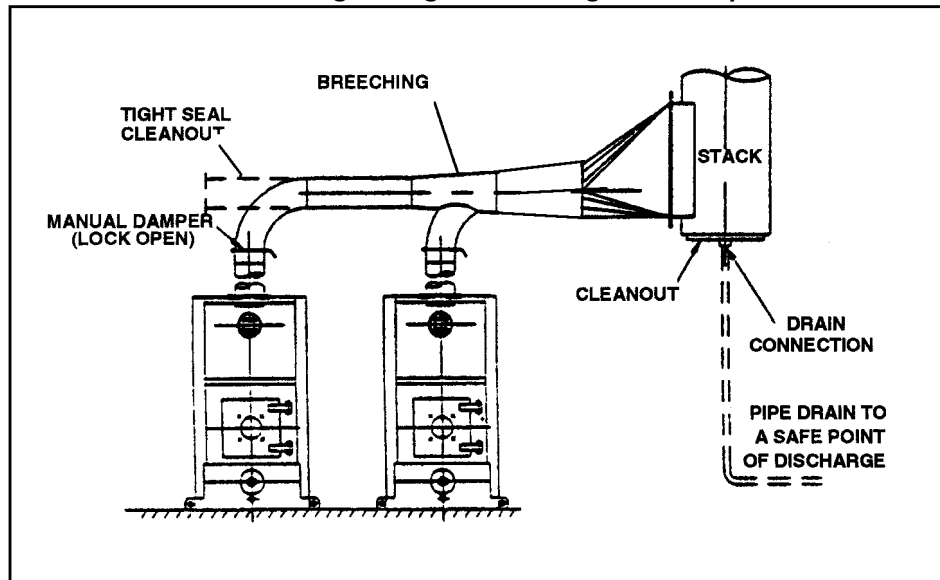



e-mail: [info@cleaverbrooks.com](mailto:info@cleaverbrooks.com)  
Web Address: <http://www.cleaverbrooks.com>