MAJOR COMPONENTS			
1	Control Panel	21	N/A
2	Entrance Panel	22	Handholes (5) 3.25" x 4.25"
3	Blower Motor - 100 HP	23	Front Sight Port
4	Air Compressor - 15 HP	24	Rear Sight Port
5	Combustion Safeguard Control - CB-780E	25	Burner
6	Flame Scanner - Infrared	26	Alarm
7	Pressure Control - Operating Limit	27	Low Fire Hold Control
8	Pressure Control - High Limit (Manual Reset)	28	N/A
9	Pressure Control - Modulating	29	N/A
10	Main Low Water Column - Levelmaster II	30	N/A
11	Auxiliary Low Water Cutoff - Warrick 3C-2	31	Bottom Blowdown Piping
12	Steam Gauge	32	Surface Blowdown Piping
13	N/A	33	N/A
14	Stack Thermometer	34	N/A
15	Safety Valve (4) Set @ 150#	35	FGR Duct
16	Gas Train	36	N/A
17	Fuel Oil Piping Terminal	37	N/A
18	Fuel Oil Pump Assembly	38	N/A
19	Manway 12" x 16"	39	N/A
20	Burner Junction Box	40	N/A

SERVICE CONNECTIONS	
A	Electric - Main Power Supply - 460 / 3 / 60
B	N/A
C	Exhaust Vent Pipe - 32" OD
D	Vent Flange (See Detail)
E	Steam Outlet - 10" 300# R.F. Flange
F	N/A
G	N/A
H	Feedwater - (2) 3.0 NPT
I	Bottom Blowdown - (2) 2.0 NPT
J	Water Column Blowdown - 0.75 NPT
K	Gauge Glass Blowdown - 0.25 NPT
L	Surface Blowoff - 1.0 NPT (With Collector Pipe)
M	N/A
N	Main Gas - TBD
O	Minimum Inlet Gas Pressure Required: 64" W.C. Maximum Inlet Gas Pressure Required: TBD Rating - TBD (cfh) MBtu
P	Oil Inlet - 0.75 NPT (75 PSI Required at Inlet)
Q	Oil Outlet - 0.75 NPT
R	Chemical Feed - 1.0 NPT
S	Safety Valve - (3) Kunkle 6010JHE 2.0 x 2.5 FPT (Outlet)
T	Safety Valve - (1) Kunkle 6010HGE 1.5 x 2.0 FPT (Outlet)

BOILER SPECIFICATIONS
Boiler Designation - CBEX-P 200 1100
Design Pressure - 150 ST
Design Rating - 1100 hp
Emissions - 30 ppm
Fuel(s) - No. 2 Oil & Natural Gas
Steam Capacity - 37,950# stm/hr @ 212 deg F
Fireside Heating Surface - 2,955 Sq. Ft.
Dry Weight - 49,000 LB
Water Weight - 32,670 LB
Gallons (Operating) - 3917
Code Compliance - FM, GE Gap, NFPA-85, Former IRI

NOTES

* Boiler Is Designed and Constructed In Accordance with the ASME Boiler and Pressure Vessel Code - Section 1 High Pressure Boiler
* This Unit Complies with Insurance Underwriters Requirement for Factory Mutual & GE Global Asset Protection
* The Boiler Package is painted with High Temperature Light Blue Enamel
* The Burner Operation Is Full Modulating
* The Boiler Burner Package Has a UL Label
* All Valves to be Mounted, Hydro Tested, & Listed on All Applicable Forms

This Boiler Is Provided with:
1. Control Circuit Transformer
2. Welded End Caps on Baserails

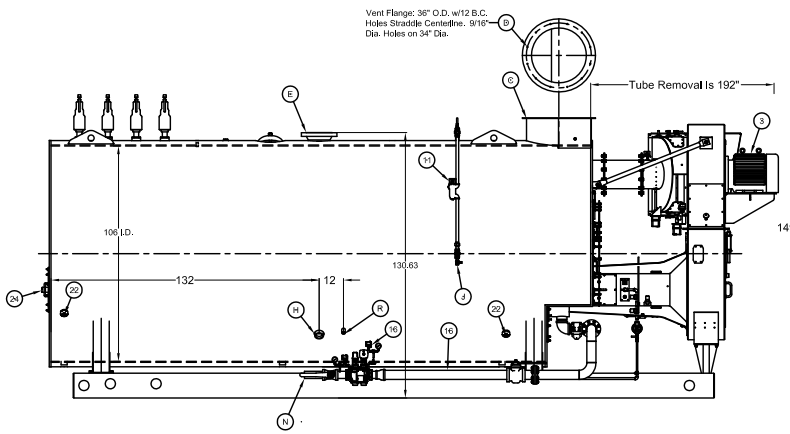

LEFT HAND VIEW

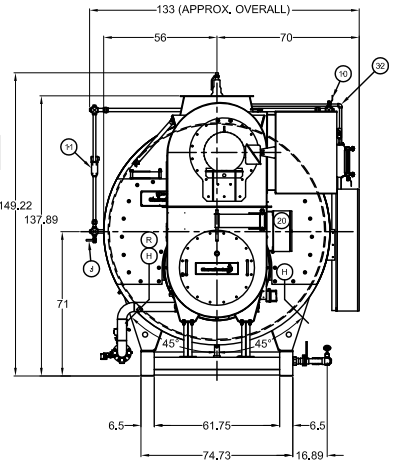

FRONT VIEW

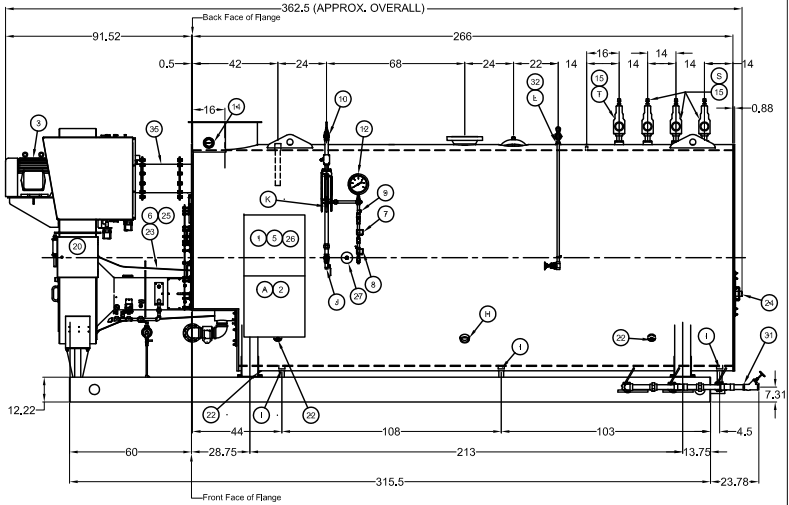

RIGHT HAND VIEW

THIS DRAWING IS PROPERTY OF CLEAVER-BROOKS DIVISION
IT IS SUBJECT TO CHANGE WITHOUT NOTICE, AND IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

REVISIONS

CAUTION

DIMENSIONS SHOWN ARE APPROXIMATE AND SHOULD NOT BE USED IN RESTRICTIVE LAYOUTS OR TO PREFABRICATE ASSEMBLIES UNLESS CLEAVER-BROOKS HAS BEEN CONSULTED. IT IS STRONGLY RECOMMENDED THAT THE CUSTOMER REQUEST AS-BUILT CERTIFIED DRAWINGS FOR THESE CASES.

WARNING

LIFTING LUGS PROVIDED ON THE VESSEL SHALL ONLY BE USED TO LIFT THE VESSEL WHEN IT IS DRY.

WARNING

CHANGES, MODIFICATIONS OR ALTERATIONS ARE STRICTLY PROHIBITED.

CHANGES TO THIS DRAWING AND SUBSEQUENT MODIFICATION OF EQUIPMENT COULD RESULT IN DAMAGE TO THE EQUIPMENT AND/OR SERIOUS PERSONAL INJURY.

Name
Address

DIMENSIONAL DIAGRAM

SIZE D | SHT 01 OF 01

SCALE N.T.S. | DATE

DRAWN LES | CHECKED BY DJM

CleaverBrooks

MODEL	FUEL	SIZE	PRESSURE	CAPACITY
CBEX-P	200	1100	150ST	
VOLTS	PHASE	HERTZ	TYPE	INSURANCE
460	3	60	3	FM&GAP

DRWG. NO. 00